

Mattole Unified School District
REQUEST FOR QUALIFICATIONS
REQUEST FOR PROPOSALS

Solar Photovoltaic System

Date Issued:
March 2, 2020

Mattole Unified School District Contact:

Karen Ashmore, Superintendent
Mattole Unified School District
29289 Chambers Road, Petrolia, CA 95558

Phone: (707) 629-3311
Email: kashmore@mattoleusd.org

Project Manager Contact:

Mike Avcollie, Project Manager
Redwood Coast Energy Authority
633 3rd Street, Eureka, CA 95501

Phone: (707) 269-1700, x 353
Email: mavcollie@redwoodenergy.org

Proposals Due on Thursday, April 2, 2020, at 3:00 pm at
633 Third Street
Eureka, CA 95501
Fax or E-mail Proposals Will Not Be Accepted

TABLE OF CONTENTS

Request for Qualifications and Request for Proposals

| | |
|----------------------------------|----------|
| Introduction and Overview | 3 |
| Statement of Work | 4 |

APPENDICES

| | |
|---|-----------|
| Appendix A: Proposed Project Schedule | 7 |
| Appendix B: Proposal Response Requirements | 8 |
| Appendix C: Energy Services Contract | 12 |
| Appendix D: Performance Bond | 56 |
| Appendix E: Payment Bond | 58 |
| Appendix F: Warranty Bond | 60 |
| Appendix G: Subcontractor List | 62 |
| Appendix H: Technical Facility Profile | 63 |
| Appendix I: Solar PV Summary Calculations | 65 |

REQUEST FOR QUALIFICATIONS/ REQUEST FOR PROPOSALS

Solar Photovoltaic Systems

Mattole Unified School District (District)

INTRODUCTION

The Mattole Unified School District (District) solicits proposals responsive to this Request for Qualifications/Request for Proposals from interested Energy Service Companies (ESCOs) to design, permit, install and commission two fully integrated and operational solar photovoltaic (PV) systems. A proposed schedule indicating the timeline for this solicitation is identified in **Appendix A: Proposed Project Schedule**. A mandatory pre-proposal site visit and question forum will be held on **Tuesday, March 17, 2020 10:00 to 11:00am** at the first site located at Mattole Elementary School 29289 Chambers Road, Petrolia, CA 9555. The second site will be at Honeydew Elementary (1 Wilder Ridge Rd, Honeydew CA 95545). The site visits and forum are designed to increase the likelihood that respondents have the applicable and appropriate information necessary to deliver proposed solutions that meet the district's expressed needs. Please allow an appropriate amount of time for attending these pre-proposal site visits as they are quite a distance apart. District is requiring attendance.

OVERVIEW

This solicitation seeks proposals for two Photovoltaic (PV) systems to be located on property owned by The District at 29289 Chambers Road, Petrolia, CA 9555. *The expected work product will be to design and implement two photovoltaic solar systems that have a total first-year production value of no less than 17,599 kWh, that complies with Division of the State Architect (DSA) requirements. There will be two (2) separate arrays installed: one (1) 8 kW DC array on the library roof at Mattole Elementary School and one (1) 4.8 kW DC array on the main classroom roof at Honeydew Elementary School.* Both are shingle covered roofs as described in **Appendix H: Technical Facility Profile**. Total allocated ECAA-Ed funding available to the District for this project, including permitting and design, is \$44,800.00. ESCO's submitting proposals are being asked to provide plans for design and installation for two systems that would incorporate this funding. The selected ESCO will work with the District to determine the best installation option/location(s), considering initial installation costs, long-term maintenance and operational costs, technical feasibility, permitting restrictions, aesthetics, customer preferences and future facility upgrades.

This procurement for design build services is authorized as an energy service contract pursuant to Government Code section 4217.12. Prior to the potential award of a contract to the selected ESCO, the District Board of Directors will adopt a resolution as required by Government Code section 4217.12, finding that the anticipated cost to the District for electrical power generation to be provided by the proposed solar power project will be less than the anticipated marginal cost to the District of electrical energy that would have been consumed by the District in the absence of this project. The contract with the selected ESCO will be the sole contract the District will hold for the completion of this project.

STATEMENT OF WORK

The scope of services provided by the selected ESCO shall include all tasks required to design, fabricate, store, deliver, install and commission fully operational PV systems for the District. Any required ancillary equipment, such as security fencing for a ground-mounted installation, or access ladders for roof-mounted panels, are included in the scope of work. The scope shall also include, but not be limited to, securing all engineering, permits and approvals from governing agencies (including DSA), all labor, taxes, services, permit fees, training and equipment necessary to produce two fully operational solar PV systems.

The selected ESCO will be expected to work with the District to design/engineer two solar PV systems to meet the District's specific design and funding criteria, and to maximize the solar energy resources, taking into consideration the District's electrical demand and load patterns, proposed installation site, available solar resources, existing site conditions, proposed future site improvements, and other relevant factors. In addition, the selected ESCO will be expected to complete installation of the systems based on a schedule as dictated by the District's funding sources for this project.

The selected ESCO will:

1. **Base Bid:** Design, Procure, Install, Test, and Commission two (2) Grid-tied Solar PV Systems.
 - a. Provide all design, labor, and materials for a turn-key, code compliant installation of an 8 kW (DC) grid tied solar photovoltaic array, or similar sized array, capable of producing 11,500 kWh /year to be installed on the south facing roof of the Library at Triple Junction High School at 29289 Chambers Road, Petrolia, CA 9555.
 - b. Provide all design, labor, and materials for a turn-key, code compliant installation of an 4.8 kW (DC) grid tied solar photovoltaic array, or similar sized array, capable of producing 6,000 kWh /year to be installed on the south facing roof of the Main Classroom Building at Honeydew Elementary School at 1 Wilder Ridge Rd, Honeydew CA 95545.
 - c. Array locations are depicted in **Appendix H: Technical Facility Profile**.
 - d. Equipment
 - i. Provide and install all solar modules, rapid shutdown devices, grid-tied inverter, racking system, means of disconnect for all AC and DC components, and all other balance of system equipment, including conduit, conductors and over current protection devices required for code compliant installations at both locations. *Minimum module efficiency of 19% or greater.*
 - e. Permitting
 - i. Obtain all permits required for installation and interconnection to utility grid.

The proposal shall contain a detailed explanation of the complete project and delineation of all work tasks to be performed by the awarded ESCO. The proposer must have the technical capability and demonstrated experience to complete the project as set out in this RFP.

The selected ESCO will be expected to furnish any and all electrical, structural and mechanical designs and specifications that are requested and/or required by DSA, or any other regulatory bodies with jurisdiction over the project.

RFQ/RFP For Solar Photovoltaic Systems

Installation of the systems are subject to California prevailing wage requirements, and the selected ESCO and its subcontractors are required to pay all workers employed for the performance of this contract no less than the applicable prevailing wage rate for each such worker. This project is X/is not subject to compliance monitoring and enforcement by the California Department of Industrial Relations pursuant to Labor Code sections 1725.5 and 1770 *et seq.* In accordance with Labor Code sections 1725.5 and 1770 *et seq.*, all contractors and subcontractors working at the sites shall be duly registered with the Department of Industrial Relations at time of bid opening and at all relevant times. Proof of registration shall be provided as to all such contractors prior to the commencement of any work.

The selected ESCO will work with the District and its representatives to determine the best approach for design. Final scope approval will be given prior to the installations.

After approval of a final design by the District and the Project Manager, and after receiving any necessary regulatory approvals, the ESCO shall provide all necessary materials, equipment, and labor to construct and successfully commission the photovoltaic system installations and interconnection with the electrical grid.

The ESCO shall provide approved training for designated District personnel in the operation of the entire photovoltaic systems, including the operation and maintenance of inverters, transfer switches, panel board, disconnects, and other features as requested by the school. The ESCO shall provide the school with written instructions and procedures for shutdown and start-up activities for all components of the systems.

All project services will comply with Energy Conservation Assistance Act (ECAA) Guidelines.

The ESCO will provide any necessary data and coordinate the project with all ECAA submission and reporting requirements. DSA's Interpretation of Regulations (IR) for solar PV installations may be found at the following link: https://www.documents.dgs.ca.gov/dsa/pubs/ir_16-8_rev10-16-12.pdf

All equipment provided by the ESCO for this Project shall have a history of successful operating experience in similar installations and shall be in new, unused condition. This equipment shall be current technology with readily available non-proprietary replacement parts. All equipment used for this Project shall be approved by the District prior to the installations.

ESCO's duties shall include but may not be limited to the following:

- Prepare construction documents where necessary.
- If necessary, hire design professionals to create plans and specifications for DSA approval.
- Ensure compliance with governing codes and standards including, but not limited, to Title 24 Standards and the California Building Code.
- Ensure compliance with all requirements for photovoltaic installations contained in the National Electric Code (NEC) and the California Electric Code (CEC), including, but not limited to, Articles 250, 310 and 690.
- Ensure compliance with ECAA requirements.
- Ensure the District participation and feedback in scoping process.
- Provide a schedule for completion of the Project.

RFQ/RFP For Solar Photovoltaic Systems

- Prepare a plan for ongoing equipment maintenance and system upgrade, if requested as an alternate.
- Ensure delivery of all materials and equipment to Site(s).
- Construct/Install Project.
- Manage all Subcontractors.
- Meet regularly to update the District representatives as to Project progress.
- Obtain and maintain all licenses, permits, and authorizations as needed for the Project.
- Commission Project: provide training on equipment/systems and monitoring if requested.
- Provide project closeout which may include As-Builts, operations and maintenance information with training, securing system and monitoring session, permits, warranties and completion documentation.
- Provide assistance with DSA close-out, if required.
- Post installation audit and energy savings tracking pursuant to Energy Conservation Assistance Act (ECAA) guidelines.

APPENDIX A: PROPOSED PROJECT SCHEDULE

The following schedule is the proposed schedule and may change during the project.

| ACTIVITY | DATE |
|--|--|
| Issue RFQ/RFP | March 2, 2020 |
| Pre-Proposal Site Visit | Tuesday, March 17, 2020 10:00 |
| Responses Due | April 2, 2020 3:00 p.m. |
| Review and Selection of Finalist(s) | April 3, 2020 |
| Interviews Scheduled and Conducted | April 3 - 9, 2020 |
| ESCO Selected/Notice of Award issued | April 9, 2020 |
| Contract Finalized/Notice to Proceed issued | April 24, 2020 |
| Conduct Design Work | April 27 – June 2020 |
| Finalize Design | June 2020 |
| Build Project | June 15, 2020 – August 21, 2020 |
| Construction Complete | no later than August 21, 2020 |
| Project Close-out and System Commissioning | August 24 – August 28, 2020 |

APPENDIX B: PROPOSAL REQUIREMENTS

For further information, please contact:

Mike Avcollie, Project Manager
Redwood Coast Energy Authority
633 3rd Street, Eureka, CA 95501

Phone: (707) 269-1700, x353
Fax: (707) 269-1777
Email: mavcollie@redwoodenergy.org

PROPOSAL REQUIREMENTS

Provide one (1) unstapled original, three (3) copies and one (1) electronic copy on a USB key at the time and place indicated in the cover letter to this RFQ/RFP. Fax or e-mail proposals will not be accepted. **Late responses will not be accepted.**

Each proposal shall be submitted in writing and must include the following information:

ESCO PROFILE & QUALIFICATIONS

The District may award the contract to the firm that, in its sole opinion, is the most capable of providing the range of services described in this RFP. To be considered for this Project, a proposer must, at a minimum, have demonstrated knowledge and experience in design, engineering and construction capabilities relevant to the scope of this RFP. The proposal must contain a response to each of the following:

- *Answer all questions or state “N/A” if not applicable.*
 - *Please number and re-state each subheading or question, followed by your response. This improves clarity and makes it much easier to evaluate your response.*
 - *Number all pages.*
1. Name, address, contact numbers, email, website, and summary of the responding ESCO’s experience with public school projects and energy upgrades.
 2. If the responding ESCO is a business entity, provide information on the type of entity, its ownership, size, and location of its principal office.
 3. All applicable licenses including license numbers and expiration dates.
 4. Detailed resume(s) of personnel to be assigned to the Project.
 - a. Identify proposed sub-ESCO(s) by name, address, and work to be performed.
 - b. Summarize the scope of services (design, construction, training, etc.) directly offered by ESCO.
 - c. Describe your qualifications and ability to design and install solar PV arrays.
 5. List at least three (3) applicable design and/or construction projects completed by the ESCO and proposed Subcontractors within the past five (5) years that are similar in size and scope. Identify similar projects by name, location, owner, size, and date constructed.

RFQ/RFP For Solar Photovoltaic System

- a. Include a list of references including contact names and telephone numbers for the representative projects.
 - b. Source of funds used for the project (if known).
6. Describe your general approach to designing and constructing building systems and how the District will be involved in the process?
7. Provide a preliminary implementation plan that includes but is not limited to:
- a. Recommended location and required ancillary activities necessary to successfully install and grid-tie the proposed systems.
 - b. Steps to ensure all applicable building codes and/or state requirements are met.
 - c. Steps to ensure all applicable labor compliance requirements are met.
 - d. Number of trainees and or apprentices to be used.
 - e. Proposed Installed kW.
 - f. Proposed First year kWh production values that meet or exceeds funding requirements
 - g. Total Installed costs that are equal to or less than the not-to-exceed amount.
 - h. Estimated first year energy cost savings
 - i. Include a system monitoring service that can be used to retrieve such data for educational purposes.
 - j. Include cybersecurity for commissioning of solar system.

The respondent shall use the following format to present project metrics. ***Proposers shall include separate tables for the separate arrays at Honeydew Elementary and Triple Junction High School.***

| <i>Size (kW DC)</i> | <i>Demand Savings (kW)</i> | <i>Year 1 Production (kWh)</i> | <i>Effective Useful Life (Years)</i> | <i>Year 1 Energy Cost Savings (\$)</i> | <i>Inverter Size (kW)</i> | <i>Measure Cost (\$)</i> |
|---------------------|----------------------------|--------------------------------|--------------------------------------|--|---------------------------|--------------------------|
| | | | | | | |

8. Confirm and briefly discuss labor, panel and inverter warranties.
9. District encourages ESCOs to maximize production and system size while saying below the project not to exceed value.
10. Public works ESCOs and Subcontractors must be registered with DIR, as specified in Labor Code section 1771.1(a). Project is subject to compliance monitoring and enforcement by DIR.
11. Proposed Price
- a. The proposed price shall include all project costs (including design fees, bonding, insurance, DSA fees, permits, materials, labor, testing, commissioning, inspection, etc.).

ENERGY CONSERVATION ASSISTANCE ACT (ECAA) REQUIREMENTS

ESCOs will be required to comply with the ECAA requirements.

ESCO acknowledges that all work must qualify as an eligible project under the ECAA guidelines; and that the Statement of Work may be amended to reflect changes in funding allocation upon mutual agreement of the Parties and a written amendment to this Contract related to any changes in scope, payment, and duration. Prior to commencement of any Work, the District shall review and approve the Project.

The ESCO will comply with and give notices required by laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on performance of the Work, including but not limited to data, quarterly reports and final reporting to the California Energy Commission required under ECAA.

COMPENSATION & PAYMENT

Compensation will have a not-to-exceed cap based on the estimated funding allocation for the approved project, and an agreement to modify (increase or decrease) the cap if ECAA funds change.

The payment schedule will be consistent with the funding allocation schedule. The ESCO will agree to maintain and make available records for inspection by the District and other agencies and will provide or assist the District in providing required reporting for the project, including data for reports to the ECAA Citizens Oversight Board.

AGREEMENT

The selected ESCO must enter into a written agreement for services using the District's form agreement for Energy Services (the "Contract"), a copy of which is included as **Appendix C**. The Contract includes the following indemnity requirement:

"ESCO shall indemnify, defend with counsel acceptable to Mattole Unified School District, and hold harmless to the full extent permitted by law, Mattole Unified School District, its governing board, officers, agents, employees, and volunteers from and against any and all liability, demands, loss, damage, claims, settlements, expenses, and costs (including, without limitation, attorney fees, expert witness fees, and costs and fees of litigation) (collectively, "Liability") of every nature arising out of or in connection with Consultant's acts or omissions with respect to this Agreement, except such Liability caused by the active negligence, sole negligence, or willful misconduct of the Mattole Unified School District. This indemnification obligation is not limited by any limitation on the amount or type of damages or compensation payable under Workers' Compensation or other employee benefit acts, or by insurance coverage limits, and shall survive the expiration or early termination of this Agreement."

SELECTION PROCESS

A selection committee will review the proposals and may select a short list of finalists for oral interviews.

REFERENCE CHECK

The District will conduct a background/reference check of the responding firms. Proposed ESCOs that appear to have the necessary qualifications and who are acknowledged as competent to provide the services requested may be placed on the short list of finalists and interviewed.

INTERVIEW

The District may interview selected respondents.

FINAL SELECTION

Predicated upon thorough review of proposals submitted and upon interviews with selected firms, the District will make a final selection and notify all finalists in writing.

The District will negotiate the final terms for services with the firm approved by the District Board. If it is not possible to reach mutual agreement with the designated firm, the District reserves the right to enter into negotiations with another firm.

The final selection will be made on the basis of best value, which includes, but is not be limited to the following criteria:

- Completeness and adherence to the requirements of this RFP.
- Qualifications and past similar experience.
- References.
- Fee and rates and base price proposal.

The District reserves the right to postpone selection for its own convenience, to withdraw this Request for Proposal at any time, and to reject any and all submittals without indicating any reason for such rejection. Submitted proposals become the property of the District.

As part of the negotiation process, the District reserves the right to require correction of technical errors in the proposal and to modify the published Statement of Work and to approve or disapprove the list of sub-consultants. Should the District determine that specific expertise is lacking in the project team, the District will reserve the right to request specific consultants with specific expertise to be added to the team. Any interpretation of, or change in, this Request for Proposal will be made by addendum, and shall become part of the Request for Proposal and any contract awarded.

Note: Pursuant to Government Code section 4529.12, District employees are prohibited from participating in the selection process when they have a financial or business relationship with any private entity seeking to enter into a contract with the District, and the District requires compliance with all laws regarding political contributions, conflicts of interest or unlawful activities.

The District reserves the right to contract with any entity responding to this Request for Proposals. The District makes no representation that participation in the Request for Proposal process will lead to an award of contract or any consideration whatsoever. The District shall in no event be responsible for the cost of preparing any proposal in response to this Request for Proposals. The selection of ESCO(s) to participate in the Request for Proposal process if at all is at the sole discretion of the District.

From the period beginning on the date of the issuance of this Request for Proposals, and ending on the date of the award of the contract, no person, or entity submitting in response to this Request for Proposals, nor any officer, employee, representative, agent, or consultant representing such a person or entity shall contact any person within the District to engage in discussion of the process of selection or award process except for the District designee for questions listed in this Request for Proposals.

APPENDIX C: ENERGY SERVICES CONTRACT

CONTRACT

This Energy Services Contract (“Contract”) is made by and between the Mattole Unified School District (“District”), and _____ (“ESCO”).

District and ESCO hereby agree as follows:

RECITALS

WHEREAS, Government Code sections 4217.10, *et seq.*, authorize the District, as a public agency, to enter into an energy services agreement wherein the ESCO provides conservation services to the District from an energy conservation facility on terms that its governing body determines are in the best interest of the District;

WHEREAS, pursuant to Government Code section 4217.11(d), “conservation services” include electrical, thermal, or other energy savings resulting from conservation measures, which shall be treated as a supply of such energy;

WHEREAS, through this Contract, the District intends to contract for the engineering, system design, fabrication and installation of photovoltaic solar systems that will result in energy savings to the District and which shall be a supply of energy to the District (the “Project”) at the following sites: Honeydew Elementary School and Mattole Elementary/Triple Junction High School (the “Project Sites” or “Sites”, and each individually a “Site”), consistent with the terms of Government Code section 4217.10, *et seq.*;

WHEREAS, the District’s Governing Board, after holding a hearing at a regularly scheduled public hearing and after having provided two weeks advanced notice of such hearing, made all findings required by Government Code section 4217.12 for the District to enter into this Contract;

WHEREAS, the ESCO shall engineer, design, and construct the Project pursuant to this Contract, including but not limited to certain General Terms and Conditions and other Contract Documents (as that term is defined in the General Conditions), which Contract Documents are incorporated into the Agreement by this reference;

NOW, THEREFORE, in consideration of the covenants hereinafter contained in this Contract, the District and ESCO agree as follows:

1. Description of Work

The ESCO will provide the design, construction, commissioning and installation of an ECAA funded project at two sites within the Mattole Unified School District. The ESCO agrees to furnish all labor, materials, equipment, plant, tools, supervision, appurtenances, and services, including transportation and utilities, required to perform and satisfactorily complete all work required for the Project. The ESCO agrees to furnish any and all electrical and mechanical designs and specifications including but not limited to performance specifications, panel layout

and mounting diagrams, electrical drawings and calculations, mechanical drawings and calculations complete with stamp and signature of a licensed California Engineer.

It shall be the responsibility of the ESCO to obtain DSA approval of the Project plans. No work shall commence at any site prior to DSA approval of the Project plans.

2. Contract Documents

The Contract Documents consist of the Complete Proposal Documents, as submitted by ESCO, including applicable drawings and calculations, the Contract, any Amendment thereto, Schematic Drawings and Specifications, Supplementary General Conditions, if any, General Conditions, Detailed Project Schedule, Proposal Requirements, Request for Proposals, Disabled Veteran Business Enterprises Requirements (if applicable), Labor Compliance Program (if applicable), all addenda, required bond(s) and insurance certificates, completed Project Questionnaire, ESCO Prequalification, all of which are incorporated herein by this reference. All Contract Documents are intended to coordinate so that any work called for in one document and not mentioned in another document is to be executed as if mentioned in all documents.

3. Proposals & Compensation

As full compensation for ESCO's complete and satisfactory performance of the work and activities described in the Contract Documents, District agrees to pay ESCO, and ESCO agrees to accept the sum of xxxxxxxxxxx (\$ xxxxxxx), which shall be paid to the ESCO according to the Contract Documents.

4. Prevailing Wages

This Project is subject to prevailing wage requirements, and ESCO and its Subcontractors are required to pay all workers employed for the performance of this contract no less than the applicable prevailing wage rate for each such worker.

5. Time for Completion

The starting date of the Contract shall be the day listed by the District in the Notice to Proceed and the ESCO shall fully complete all the work as detailed in accordance with **Appendix A** of the RFP: Proposed Project Schedule. Time is of the essence in the performance of this Contract.

6. Liquidated Damages

Liquidated damages for ESCO's failure to complete the Contract within the time fixed for completion inclusive of milestone dates are established in the amount of \$200 per day per each Milestone until that Milestone is completed.

IN WITNESS WHEREOF, the parties agree to the terms of this Contract on the day and year written below.

District Authorized Signature

ESCO

Resolution No. _____

ESCO License No and Expiration Date

Date

By: _____
Individual Signature

Title

Date

For: _____
Corporation or Partnership

If Corporation, Seal Below.

For use by NCSIG Members:

Certificates of Insurance and Bonds Approved

By: _____
Director, JPA Services

Date: _____

**General Conditions to Design-Build Contract for:
Solar Photovoltaic System
Mattole Unified School District**

GENERAL CONDITIONS TABLE OF CONTENTS

| | |
|---|-----------|
| 1. DEFINITIONS | 18 |
| 2. PROJECT MANAGER | 19 |
| 3. CONTRACT DOCUMENTS | 19 |
| 4. INTENT OF DRAWINGS AND SPECIFICATIONS | 20 |
| 5. TRADE DIVISIONS | 21 |
| 6. MASTER MANDATORY PROVISIONS | 21 |
| 7. ESCO | 22 |
| 8. RESPONSIBILITY OF ESCO | 22 |
| 9. SUBCONTRACTORS | 23 |
| 10. PERFORMANCE AND PAYMENT BONDS | 23 |
| 11. INSURANCE | 24 |
| 12. CODES AND REGULATIONS | 26 |
| 13. PERMITS AND TAXES | 27 |
| 14. PATENTS AND ROYALTIES | 27 |
| 15. SAFETY AND FIRE PREVENTION | 27 |
| 16. HAZARDOUS MATERIALS | 28 |
| 17. TEMPORARY FACILITIES | 29 |
| 18. SIGNS | 30 |
| 19. TIME | 30 |
| 20. PRE-CONSTRUCTION & CONSTRUCTION SCHEDULE | 30 |
| 21. DELAYS AND TIME EXTENSIONS | 31 |

RFQ/RFP For Solar Photovoltaic System

| | |
|---|-----------|
| 22. LIQUIDATED DAMAGES | 31 |
| 23. DISTRICT'S RIGHT TO STOP WORK; TERMINATION OR SUSPENSION OF THE CONTRACT | 32 |
| 24. ASSIGNMENT OF CONTRACT | 33 |
| 25. COORDINATION WITH OTHER CONTRACTS | 33 |
| 26. SUBMITTALS: SHOP DRAWINGS, CUTS AND SAMPLES | 34 |
| 27. PAYMENTS | 34 |
| 28. MODIFICATIONS OF CONTRACT | 36 |
| 29. INDEMNITY | 38 |
| 30. WARRANTY OF TITLE | 39 |
| 31. USE OF COMPLETED PARTS OF THE WORK BEFORE ACCEPTANCE | 39 |
| 32. GUARANTEE & WARRANTY | 39 |
| 33. PROTECTION OF WORK AND PROPERTY | 40 |
| 34. USE OF ROADWAYS AND WALKWAYS | 40 |
| 35. MATERIALS | 40 |
| 36. SUBSTITUTIONS | 41 |
| 37. TESTING | 42 |
| 38. INSPECTION | 42 |
| 39. CLEANUP | 43 |
| 40. CONSTRUCTION WASTE MANAGEMENT | 43 |
| 41. INSTRUCTIONS AND MANUALS | 45 |
| 42. AS-BUILT DRAWINGS | 46 |
| 43. SUBSTITUTION OF SECURITIES | 46 |
| 44. NO DISCRIMINATION | 47 |
| 45. LABOR STANDARDS | 47 |
| 46. GENERAL RATE OF PER DIEM WAGES | 47 |

RFQ/RFP For Solar Photovoltaic System

| | |
|--|-----------|
| 47. RECORD KEEPING | 48 |
| 48. PROJECT COMPLETION | 49 |
| 49. TRENCHING OR OTHER EXCAVATIONS | 49 |
| 50. RESOLUTION OF CONSTRUCTION CLAIMS | 51 |
| 51. DISABLED VETERANS PARTICIPATION GOALS (APPLIES TO K-12 DISTRICTS ONLY.) | 52 |
| 52. RETENTION OF DVBE RECORDS (APPLIES TO K-12 DISTRICTS ONLY.) | 52 |
| 53. FINGERPRINTING (APPLIES TO K-12 DISTRICTS ONLY.) | 53 |
| 55. DRUG-FREE WORKPLACE CERTIFICATION | 54 |
| 56. PROVISIONS REQUIRED BY LAW DEEMED INSERTED | 54 |
| 57. GENERAL PROVISIONS | 54 |
| APPENDIX D: PERFORMANCE BOND | 56 |
| APPENDIX E: PAYMENT BOND | 58 |
| APPENDIX F: WARRANTY BOND | 60 |
| APPENDIX G: SUBCONTRACTOR LIST FORM | 62 |
| APPENDIX H: TECHNICAL FACILITY PROFILE | 63 |
| APPENDIX I: SOLAR PV SUMMARY CALCULATIONS | 65 |

RFQ/RFP For Solar Photovoltaic System

1. DEFINITIONS

Addendum: A written change or revision to the Contract Documents issued to the prospective proposers prior to the time of receiving proposals.

Alternate: The sum to be added to or deducted from the base proposal if the change in scope of work as described in Alternates is accepted by the District.

Approved: Approved by the District or the District's authorized representative unless otherwise indicated in the Contract Documents.

Architect: The person or firm holding a valid license to practice architecture or engineering which has been designated (if any designated) to provide architectural or engineering design services on this Project. When Architect is referred to within the Contract Documents and no architect or engineer has in fact been designated, then the matter shall be referred to the District Superintendent or its Project Manager.

As Directed: As directed by the District or its Project Manager, unless otherwise indicated in the Contract Documents.

As Selected: As selected by the District or its Project Manager, unless otherwise indicated in the Contract Documents.

Construction Manager: The individual or entity named as such by the District. If no Construction Manager is designated for the project, all references to the Construction Manager in these Contract Documents shall mean the District and/or its Project Manager.

Contract: The legally binding agreement between the District and the ESCO wherein the ESCO agrees to furnish the labor, materials, equipment, and appurtenances required to perform the work described in the Contract Documents and the District agrees to pay the ESCO for such work.

Contract Documents: The Contract Documents are described in the Contract for this Project.

District and/or Owner: The District, its governing board, authorized officers and employees, and authorized representatives.

DSA: The State of California Division of the State Architect which has the authority to review, approve and inspect the safety of design, alteration and construction of school buildings.

DSA Pre-Check (PC) Approved: An "over-the-counter" design of a structure that is pre-approved by the DSA.

ESCO: The person or entity holding a valid license in the State of California required for performing this Project and who has contracted with the District to perform the construction work described in the Contract Documents. The term ESCO shall be construed to mean all the officers, employees, Subcontractors, suppliers, or other persons engaged by the ESCO for the work of this Project.

Final Completion: Final Completion is achieved when the ESCO has fully completed all Contract Document requirements, including, but not limited to, all final punch list items and project closeout, to the District's satisfaction.

Furnish: Purchase and deliver to site of installation.

Governing Board: The Governing Board of the Mattole Unified School District.

RFQ/RFP For Solar Photovoltaic System

Inspector: The person engaged by the District, pursuant to Section 17311 of the Education Code, to inspect the workmanship, materials, and manner of construction of buildings or portions of buildings to determine if such construction complies with the Contract Documents and applicable codes and regulations.

Indicated (or) As Shown: Shown on drawings and/or as specified.

Install: Fix in place, for materials; and fix in place and connect, for equipment.

Modification: An authorized change to the Contract Documents which may or may not include a change in contract price and/or time.

Project: The total construction work and activities described in these Contract Documents.

Project Manager: Redwood Coast Energy Authority (RCEA) serves as the ECAA-Ed Project Manager for this Project.

Proposal: The properly completed and signed proposal to perform the construction work for the Project as described in the Contract Documents.

Secure: Obtain.

Subcontractor: A person, firm, or corporation duly licensed in the State of California who has a contract with the ESCO to furnish labor, materials and equipment, and/or to install materials and equipment for work in this Contract.

2. PROJECT MANAGER

a. Role and Responsibilities

The Project Manager is responsible for the general oversight of all the working drawings, technical Specifications, sketches and other information necessary to define the work covered by these Contract Documents as generated by the ESCO. The Project Manager shall visit, inspect and observe the construction to determine general compliance with the Contract Documents. The Project Manager shall evaluate the shop drawings, samples and other submittals required in the technical Specifications, and maintain an up-to-date log of all such items processed. The Project Manager will consult with the District, ESCO, and any state, county or city agency having jurisdiction over the work whenever necessary to further the best interests of the Project.

b. Disputes

Should any dispute arise respecting interpretation of the drawings and Specifications, the value of any work done or of any work omitted, or of any extra work which ESCO may be required to do or respecting the size of any payment to ESCO during the performance of this Contract, the dispute shall be decided by the Project Manager, and the Project Manager's decision shall be final and conclusive.

3. CONTRACT DOCUMENTS

a. Contents and Precedence

The Contract Documents consist of the executed Contract and all Addenda, all approved change orders, the completed Request for Proposals Form, the required Bonds and the Insurance forms, the Request for Proposals, the Notice of Award, the Notice to Proceed, the General Conditions, any supplemental Conditions, the Technical Specifications, and the Drawings. The Contract Documents

RFQ/RFP For Solar Photovoltaic System

are complementary, and anything required by one shall be as binding as if required by all. In case of conflicts within the Contract Documents, the order of precedence of interpretation shall be as listed above, with the executed Contract and any change order thereto having priority, and subsequent Addenda having priority over prior Addenda only to the extent modified by the subsequent Addenda. In case of conflict within the drawings, larger scale drawings shall govern smaller scale drawings, and written dimensions shall govern over scaled dimensions.

b. Ambiguities, Errors, and Inconsistencies

If, in the opinion of the ESCO, the construction details indicated on the drawings or otherwise specified are in conflict with accepted industry standards for quality construction and therefore might interfere with its full guarantee of the work involved, the ESCO shall promptly bring this information to the attention of the Project Manager for appropriate action before submittal of the proposal. ESCO's failure to request clarification or interpretation of an apparent ambiguity, error or inconsistency waives that ESCO's right to thereafter claim any entitlement to additional compensation based upon an ambiguity, inconsistency, or error, which should have been discovered by a reasonably prudent ESCO, subject to the limitations of Public Contract Code §1104. During the Project, should any discrepancy appear, or any misunderstanding arise as to the import of anything contained in the Contract Documents, the matter shall be promptly referred to the Project Manager, who will issue instructions or corrections.

c. Lines and Planes

All lines and planes appearing on contract drawings to be horizontal or vertical and not explicitly indicated otherwise shall be constructed true and plumb. All lines and planes appearing on contract drawings to intersect at right angles and not explicitly indicated otherwise shall be constructed at true right angles. Where details are indicated covering specific conditions, such details also apply to all similar conditions not specifically indicated.

d. Standards

The specification standards of the various sections of the Specifications shall be the procedural, performance, and material standards of the applicable association publications identified and shall be the required level of installation, materials, workmanship, and performance for the applicable work. Except where a specific date of issue is mentioned hereinafter, references to specification standards shall mean the edition, including amendments and supplements, in effect on the date of the Request for Proposals. Where no standard is identified, and a manufacturer is specified, the manufacturer's specifications are the standards. All standards shall be subordinate to the requirements of the applicable codes and regulations.

e. Reference to the Singular

Wherever in the Specifications an article, device or piece of equipment is referred to in the singular number; such reference shall include as many such items as are shown on Drawings or required to complete the installation.

4. INTENT OF DRAWINGS AND SPECIFICATIONS

a. Drawings and Specifications are to be read as an integrated document. The ESCO shall promptly report to the Project Manager any ambiguities, discrepancies, or errors which come to the ESCO's attention.

RFQ/RFP For Solar Photovoltaic System

- b. Figured dimensions shall be followed in preference to scaled dimensions, and the ESCO shall make all additional measurements necessary for the work and shall be responsible for their accuracy. Before ordering any material or doing any work, the ESCO shall verify all measurements at the Project site and shall be responsible for the correctness of same.
- c. It is the intent of the drawings and Specifications to show and describe complete installations. Items shown but not specified, or specified but not shown, shall be included unless specifically omitted.
- d. The Specifications shall be deemed to include and require everything necessary and reasonably incidental to the completion of all work described and indicated on the drawings, whether particularly mentioned or shown, or not.

5. TRADE DIVISIONS

Segregation of the Specifications into the designated trade divisions is only for the purpose of facilitating descriptions and shall not be considered as limiting the work of any subcontract or trade. Subject to other necessary provisions set forth in the Specifications, the terms and conditions of such limitations or inclusions shall lie solely between the ESCO and its Subcontractors. "Scope" as indicated in each section of the Specifications shall serve only as a general guide to what is included in that section. Neither the stated description nor the division of the plans and Specifications to various sections, which is done solely for convenience, shall be deemed to limit the work required, divide or indicate it by labor jurisdiction or trade practice, or set up any bidding barriers to the various Subcontractors or suppliers.

- a. The ESCO shall be responsible for the proper execution of all work required by the Contract Documents and for allocating such portions as the ESCO sees fit to the various Subcontractors, subject to applicable law. The ESCO is cautioned that the various individual sections may not contain all work that the ESCO may wish to allocate to a particular Subcontractor or everything bearing on the work of a particular trade, some of which may appear in other portions of the plans or Specifications.
- b. If the ESCO elects to enter into any subcontract for any section of the work the ESCO assumes all responsibility for ascertaining that the Subcontractor for the work is competent, licensed, solvent, thoroughly acquainted with all conditions and legal requirements of the work, has included all materials and appurtenances in connection therewith in the subcontract, and has performed its work in strict compliance with the Contract Documents.
- c. It shall be the responsibility of the ESCO to notify each prospective Subcontractor at the time of request for proposals of all portions of the Contract Documents, including the General Conditions, Supplementary Conditions and any parts of sections of Specifications or plans that the ESCO intends to include as part of the subcontract.

6. MASTER MANDATORY PROVISIONS

- a. Any material, item, or piece of equipment mentioned, listed or indicated without definition of quality, shall be consistent with the quality of adjacent or related materials, items, or pieces of equipment on the Project and in accordance with best practices.
- b. Any method of installation, finish, or workmanship of an operation called for, without definition of standard of workmanship, shall be followed or performed and finished in accordance with best practices and consistent with adjacent or related installations on the Project.

RFQ/RFP For Solar Photovoltaic System

- c. Any necessary material, item, piece of equipment or operation not called for but reasonably implied as necessary for proper completion of the work shall be furnished, installed or performed and finished; and shall be consistent with adjacent or related materials, items, or pieces of equipment on the Project, and in accordance with best practices.
- d. Names or numbered products are to be used according to the manufacturers' directions or recommendations unless otherwise specified.

7. ESCO

- a. The ESCO shall perform all the work and activities required by the Contract Documents and furnish all labor, materials, equipment, tools and appurtenances necessary to perform the work and complete it to the District's satisfaction within the time specified. The ESCO shall at all times perform the work of this Contract in a competent and workmanlike manner and, if not specifically stated, accomplish the work according to the best standards of construction practice. The ESCO in no way is relieved of any responsibility by the activities of the Project Manager, engineer, inspector or DSA in the performance of such duties.
- b. The ESCO shall employ a full-time competent superintendent and necessary assistants who shall have complete authority to act for the ESCO on all matters pertaining to the work. The superintendent shall be satisfactory to the District and, if not satisfactory, shall be replaced by the ESCO with one that is acceptable. Also, the superintendent shall not be changed without the written consent of the District unless the superintendent ceases to be employed by the ESCO.
- c. ESCO shall make the layout of lines and elevations and shall be responsible for the accuracy of both the ESCO's and the Subcontractors' work resulting there from. All dimensions affecting proper fabrication and installation of all Contract work must be verified by the ESCO prior to fabrication and installation by taking field measurements of the true conditions. The ESCO shall take, and assist Subcontractors in taking, all field dimensions required in performance of the work, and shall verify all dimensions and conditions on the site. If there are any discrepancies between dimensions in drawings and existing conditions which will affect the work, the ESCO shall promptly bring such discrepancies to the attention of the Project Manager for adjustment before proceeding with the work. ESCO shall be responsible for the proper fitting of all work and for the coordination of all trades, Subcontractors and persons engaged upon this Contract.
- d. ESCO shall do all cutting, fitting, or patching of ESCO's work that may be required to make its several parts come together properly and fit it to receive or be received by work of other ESCOs as shown, or reasonably implied by, the drawings and Specifications for the completed work. Any cost incurred by the District due to defective or ill-timed work shall be borne by the ESCO.

8. RESPONSIBILITY OF ESCO

- a. ESCO shall be held strictly responsible for the proper performance of all work covered by the Contract Documents, including all work performed by Subcontractors. All work performed under this Contract shall comply in every respect to the rules and regulations of all agencies having jurisdiction over the Project or any part thereof.
- b. ESCO shall perform the duties and submit Verified Reports as defined in Sections 4-336 and 4-343 (c), Group 1, Chapter 4, Part I, Title 24, California Code of Regulations ("CCR"). The duties of the ESCO are as defined in Section 4-343, Group 1, Chapter 4, Part I, Title 24, of the CCR. ESCO shall keep and make available a copy of Title 24 of the CCR at the job site at all times.

RFQ/RFP For Solar Photovoltaic System

- c. Where, because of short supply, any item of fabricated materials and/or equipment, indicated on drawings or specified, is unobtainable and it becomes necessary, with the consent of the Project Manager, to substitute equivalent items differing in details or design, the ESCO shall promptly submit complete drawings and details indicating the necessary modifications of the work. This provision shall be governed by the terms of the General Conditions regarding Submittals: Shop Drawings, Cuts and Samples.
- d. With respect to work performed at and near a school site, ESCO shall at all times take all appropriate measures to ensure the security and safety of students and staff, including, but not limited to, ensuring that all of ESCO's employees, Subcontractors, and suppliers entering school property strictly adhere to all applicable District policies and procedures, e.g., sign-in requirements, visitor badges, and access limitations.

9. SUBCONTRACTORS

- a. Nothing contained in the Contract Documents shall create any contractual relationship between any Subcontractor and the District. The District shall be deemed to be the third-party beneficiary of the contract between the ESCO and each Subcontractor. If the ESCO does not specify a Subcontractor for any portion of the work to be performed under this Contract, as required by law, ESCO shall perform that portion of the work with its own forces. The ESCO shall not substitute any other person or firm as a Subcontractor for those listed in the proposal submitted by the ESCO, without the written approval of the District and in conformance with the requirements of the Public Contract Code. The District reserves the right of approval of all Subcontractors proposed for use on this Project, and to this end, may require financial, performance, and such additional information as is needed to secure this approval. If a Subcontractor is not approved, the ESCO shall promptly submit another firm of the same trade for approval.
- b. The ESCO shall insert appropriate provisions in all subcontracts pertaining to work on this Project requiring the Subcontractors to be bound by all applicable terms of the Contract Documents. The ESCO shall be as fully responsible for the acts and omissions of the Subcontractors, and of persons either directly or indirectly employed by them, as the ESCO is for the acts and omissions of persons directly employed by the ESCO.
- c. The ESCO shall provide a Subcontractor List Form, in the form of **Appendix G** attached hereto, for any subcontractor performing more than one half of one percent of work on the project.

10. PERFORMANCE AND PAYMENT BONDS

- a. As directed in the Notice of Award, the ESCO shall file with the District the following bonds, using the bond forms provided with these Contract Documents:
- 1) A corporate surety bond, in a sum not less than 100 percent of the amount of the Contract, to guarantee the faithful performance of the Contract, substantially in form of **Appendix D**, attached hereto.
 - 2) A corporate surety bond, in a sum not less than 100 percent of the amount of the Contract, to guarantee the payment of wages for services engaged and of bills contracted for materials, supplies, and equipment used in the performance of the Contract, substantially in the form of **Appendix E**, attached hereto.

RFQ/RFP For Solar Photovoltaic System

- b. Corporate sureties on these bonds and on bonds accompanying proposals must be admitted sureties as defined by law, legally authorized to engage in the business of furnishing surety bonds in the State of California. All sureties and bond forms must be satisfactory to the District. Failure to submit the required bonds within the time specified by the Notice of Award, using the forms provided by the District, may result in cancellation of the award of Contract.
- c. The amount of the Contract, as used to determine the amounts of the bonds, shall be the total amount fixed in the ESCO's proposal for the performance of the required work.
- d. During the period covered by the Contract, if any of the sureties upon the bonds shall become insolvent or unable, in the opinion of the District, to pay promptly the amount of such bonds to the extent to which surety might be liable, the ESCO, within thirty (30) days after notice given by the District to the ESCO, shall provide supplemental bonds or otherwise substitute another and sufficient surety approved by the District in place of the surety becoming insolvent or unable to pay. If the ESCO fails within such thirty (30) day period to substitute another and sufficient surety, the ESCO shall, if the District so elects, be deemed to be in default in the performance of its obligations hereunder, and the District, in addition to any and all other remedies, may terminate the Contract or bring any proper suit or other proceedings against the ESCO and the sureties or any of them, or may deduct from any monies then due or which thereafter may become due to the ESCO under the Contract, the amount for which the surety, insolvent or unable to pay, shall have been liable on the bonds, and the monies so deducted shall be held by the District as collateral security for the performance of the conditions of the bonds.
- e. Must provide one electronic copy and two hardcopies set of the bonds to the Project Manager to send to the District for signature.

11. INSURANCE

- a. ESCO shall obtain the following insurance from a company or companies acceptable to the District. All required insurance must be written by a company licensed to do business in the State of California at the time the policy is issued. All required insurance shall be equal to or exceed an A VIII rating as listed in Best's Insurance Guides' latest edition. On a case-by-case basis, the District may accept insurance written by a company listed on the State of California Department of Insurance List of Eligible Surplus Lines ("LESLI List") with a rating of A VIII or above as listed in Best's Insurance Guides' latest edition. Required documentation of such insurance shall be furnished to the District within the time stated in the Notice of Award. ESCO shall not commence work nor shall it allow its employees or Subcontractors or anyone to commence work until all insurance required hereunder has been submitted and approved in writing by the District and a notice to proceed has been issued.
- b. ESCO shall take out and maintain at all times during the life of this Contract, up to the date of acceptance of the work by the District, the following policies of insurance:
 - 1). General Liability Insurance: Personal injury and replacement value property damage insurance for all activities of the ESCO and its Subcontractors arising out of or in connection with this Contract, written on a comprehensive general liability form including ESCO's protected coverage, blanket contractual, completed operations, vehicle coverage and employer's non-ownership liability coverage, in an amount no less than either
 - a. \$1,000,000.00 combined single limit personal injury and property damage for each occurrence and \$2,000,000.00 annual aggregate with a \$0 umbrella/excess; or

RFQ/RFP For Solar Photovoltaic System

b. \$2,000,000.00 annual combined single limit

2). Builders' Risk Insurance: For a proposal over \$225,000, ESCO shall procure and maintain builders' risk insurance (all-risk coverage) for an amount equal to one hundred percent of the Contract sum for the benefit of the District, and the ESCO and Subcontractors as their interest may appear. In projects involving no structural change or building construction, this requirement may be waived in writing, at the District's sole option.

These policies shall include the following coverage:

- 1). The inclusion of more than one insured shall not operate to impair the rights of one insured against another insured and the coverages afforded shall apply as though separate policies have been issued to each insured.
- 2). This policy does not exclude explosion, collapse, underground excavation hazard, or removal of lateral support.

c. Endorsements:

1). The certificate(s) for both the General Liability Policy and the Automobile Liability Policy, as well the Builders' Risk Policy if required above, shall be endorsed *with the following specific language*:

“The Mattole Unified School District is named as an additional insured for all liability arising out of the operations by or on behalf of the named insured, and this policy protects the additional insured, its officers, agents and employees against liability for bodily injuries, death or property damage or destruction arising in any respect directly or indirectly in the performance of the Contract.”

2) The certificates must state that the insurance is under an occurrence based, and not a claims-made policy (policies). Both the General Liability Policy and the Builders' Risk Policy specified above shall be endorsed with the following specific language:

- a. The insurance provided herein is primary and no insurance held or owned by the District shall be called upon to contribute to a loss.
- b. Coverage provided by this policy shall not be reduced or canceled without thirty (30) days written notice given to the District by certified mail.

d. Professional Liability Insurance for Engineer of Record (Errors and Omissions):

If applicable, ESCO shall maintain in force for the period covered by this Agreement, professional liability (errors and omissions) insurance covering the Engineer of Record's activities, in the amount not less than \$2,000,000 with an insurance carrier satisfactory to District. In addition, to the extent that the activities and services of engineers or consultants retained by ESCO are not covered under ESCO's professional liability insurance, ESCO shall require each engineer and consultant to obtain and maintain a policy of professional liability insurance in an amount of not less than \$2,000,000 with an insurance carrier satisfactory to District, before commencing services on the Project. ESCO shall provide a copy of the insurance policies to the District upon request.

e. Automobile Liability Insurance:

ESCO shall maintain in force for the period covered by this Agreement, automobile liability insurance covering bodily injury and property damage in an amount no less than \$1,000,000 combined single limit for each occurrence; \$2,000,000 aggregate. Said insurance shall include coverage for owned, hired, rented, and non-owned vehicles. All certificates must state that the insurance is under an occurrence based, and not a claims-made policy (policies).

RFQ/RFP For Solar Photovoltaic System

f. Documentation:

Within ten (10) calendar days following issuance of the Notice of Award of the Contract, the following documentation of insurance shall be submitted to the Project Manager electronically to send to the District for approval prior to issuance of the Notice to Proceed, signed certificates of insurance showing the limits of insurance provided and copies of the specified endorsements for each policy. Certified copies of all policies shall be provided to the District upon request.

g. If the ESCO fails to maintain such insurance, the District may take out such insurance to cover any damages for which the District might be held liable on account of the ESCO's failure to pay such damages and deduct and retain the amount of the premiums from any sums due the ESCO under the Contract.

h. Workers' Compensation Insurance:

1). Within ten (10) calendar days following issuance of the Notice of Award of the Contract, the ESCO shall submit to Project Manager electronically in order to send to the District satisfactory proof that the ESCO **and all Subcontractors it intends to employ** have procured, for the period covered by the Contract, full Workers' Compensation insurance and employer's liability with limits of at least \$1,000,000 with an insurance carrier satisfactory to the District for all persons whom the ESCO may employ in carrying out the work contemplated under this Contract in accordance with the Workers' Compensation Insurance and Safety Act, approved May 26, 1913, and all acts amendatory or supplemental thereto (the "Act"). Such insurance shall be maintained in full force and effect during the period covered by the Contract. In the event the ESCO is self-insured, ESCO shall furnish a Certificate of Permission to Self-Insure, signed by the Department of Industrial Relations Administration of Self-Insurance, Sacramento, California.

2). If the ESCO fails to maintain such insurance, the District may take out worker's compensation insurance to cover any compensation which the District might be liable to pay under the provisions of the Act, by reason of any employee of the ESCO being injured or killed and deduct and retain the amount of the premiums for such insurance from any sums due the ESCO under the Contract, or otherwise recover that amount from the ESCO or the Surety.

3). If an injury occurs to any employee of the ESCO for which the employee, or the employee's dependents in the event of the employee's death, is entitled to compensation under the provisions of the Act, or for which compensation is claimed from the District, the District may retain from the sums due the ESCO under this Contract an amount sufficient to cover such compensation, as fixed by the Act, until such compensation is paid, or until it is determined that no compensation is due, and if the District is compelled to pay such compensation, it will deduct and retain from such sums the amount so paid, or otherwise recover this sum from the ESCO or its Surety.

4). The policies represented by the certificates shall be endorsed with a Waiver of Subrogation and must contain the provision (and the certificates must so state) that the insurance cannot be canceled until thirty (30) days after written notice of intended cancellation has been given to the District by certified mail.

12. CODES AND REGULATIONS

a. The ESCO shall be knowledgeable regarding and shall comply with applicable portions of California Code of Regulations Title 24, the applicable Building Code, and all other codes, ordinances, regulations or orders of properly constituted authority having jurisdiction over the work of this Project. The ESCO shall examine the Contract Documents for compliance with these codes and regulations and shall promptly notify the Project Manager of any discrepancies.

RFQ/RFP For Solar Photovoltaic System

b. All work, and materials shall be in full accordance with the latest rules and regulations of the Safety Orders of the Division of Industrial Safety, the National Electric Code, the Uniform Plumbing Code published by the Western Plumbing Officials Association, and other applicable State laws or regulations. Nothing in the Project plans or Specifications is to be construed to permit work not conforming to the applicable Codes. Buildings and/or all other construction covered by this Contract shall meet all the regulations for access by the physically handicapped as administered by the Division of the State Architect, and as may be required by federal or state law.

c. If the work under this Contract is for the construction of a school building as defined by the Education Code, then the following provisions shall apply to the Contract:

1). All work shall be executed in accordance with the current requirements of Sections 17280 et seq. or Sections 81130 of the Education Code and California Code of Regulations: Title 24 and Title 19. No deviations from the DSA approved plans and Specifications will be permitted except upon a Change Order or Addenda, signed by the District and Architect and approved by the Division of the State Architect and the State Fire Marshal, if applicable.

2). Prior to the start of construction, District shall employ a Project Inspector, approved by the Division of the State Architect, to provide inspection services as defined in Title 24, California Code of Regulations and pursuant to Section 17311 of the Education Code. The Owner shall pay for the costs of the project inspection services, except as indicated in the General Conditions, Article 38 and the plans and Specifications. A copy of current California Code of Regulations Title 24, approved sets of plans and Specifications, addenda and change orders, shall be kept by the School District Job Inspector on the job at all times during construction. Division of the State Architect shall be notified 48 hours in advance of the first pour of concrete

13. PERMITS AND TAXES

a. The ESCO shall obtain and pay for all permits, fees and licenses that are required in order to perform the work under this Contract. The District shall pay connection charges and meter costs for new permanent utilities required by these Contract Documents. The ESCO shall notify the District sufficiently in advance to submit requests for service to the appropriate utility companies to insure connections or installation of utility services in accordance with the Project schedule.

b. The ESCO shall pay for all taxes on materials and equipment. The District is exempt from Federal Excise Tax. ESCO shall not pay Federal Excise Tax on any item in this Contract.

14. PATENTS AND ROYALTIES

All fees or claims for patents, royalties or licenses on materials, equipment or processes used in the performance of work on this Project shall be included in the amount of the proposal. The ESCO shall indemnify, defend, and hold harmless the District, its Governing Board, the Project Manager, and their officers and employees, from all claims or liability, including costs and expenses, which may arise from the use on this Project of any patented or copyrighted materials, equipment, or processes.

15. SAFETY AND FIRE PREVENTION

a. The ESCO, Subcontractors and all their agents and employees shall fully comply with all the provisions and requirements of CAL/OSHA, Title 8, California Code of Regulations, and all other safety codes applicable to the Project. The ESCO shall always take thorough precautions for the protection of persons and property and shall be liable for all damages to persons or property, either on or off the site, which occur as a result of ESCO's prosecution of the work. The ESCO shall obtain permits for, install and maintain in safe condition barricades, walkways, fences, railings, and

RFQ/RFP For Solar Photovoltaic System

whatever other safeguards that may be necessary to protect persons and property from damage as a result of the construction under this Contract.

- b. ESCO is required to ensure Material Safety Data Sheets (“MSDS”) are available in a readily accessible place at the work site for any material requiring a MSDS pursuant to the federal "Hazard Communication" standard or employee "right to know" laws. ESCO is also required to ensure proper labeling on materials brought on the job site such that any person working with the material or within the general area of the material is informed of the hazards of the material and follows proper handling and protection procedures. A copy of the MSDS shall also be promptly submitted directly to the District.
- c. ESCO shall not endanger any work by cutting, excavating, or otherwise altering the work and shall not cut or alter the work of any other ESCO except with the written consent of the Project Manager, nor overload any new or existing structures by the placing or storage of materials, equipment, or other items thereon, and, if necessary, shall provide calculations proving the safety in so doing.
- d. If it is necessary to work at night, or where daylight is obscured, the ESCO shall provide and maintain lighting of an adequate level to properly prosecute the work, to permit the thorough inspection of same, and to ensure the safety to workers and others.
- e. ESCO shall take extraordinary care to prevent fires and keep all flammable materials and oily rags in tightly closed metal containers. ESCO shall exercise particular care when welding or cutting, and with regard to the disposition of waste materials, the nature and quantity of which might create or increase a fire hazard.

16. HAZARDOUS MATERIALS

Unless otherwise specified, this Contract does not include the removal, handling, or disturbance of any hazardous substances or materials encountered in the new construction or on the Project grounds. If such substances or materials are encountered, work shall cease in that area and the District shall be promptly notified to take appropriate action for removal or otherwise abating the condition in accordance with current regulations applicable to the District.

a. General

- 1). No asbestos, asbestos-containing products or other hazardous materials shall be used in this construction or in any tools, devices, clothing or equipment used to further this construction.
 - 2). Asbestos and/or asbestos containing products shall be defined as all items containing but not limited to chrysotile, crocidolite, amosite, anthophyllite, tremo-lite or actinolite.
 - 3). Any or all material containing greater than one tenth of one percent (>.1%) asbestos shall be defined as asbestos-containing material.
 - 4). Any disputes involving the question of whether material contains asbestos shall be settled by electron microscopy; the cost of any such tests shall be paid by the ESCO.
 - 5). All work or materials found to contain asbestos or work or material installed with asbestos containing equipment will be immediately rejected and this work shall be removed by the ESCO at no additional cost to the District.
- b. Decontamination and Removal of hazardous material from prior work

RFQ/RFP For Solar Photovoltaic System

- 1). Decontamination and removal of work found to contain asbestos or work installed with asbestos containing equipment shall be done only under the supervision of a qualified consultant, knowledgeable in the field of asbestos abatement and accredited by the Environmental Protection Agency (“EPA”).
- 2). The asbestos removal ESCO shall be an EPA-accredited ESCO qualified in the removal of asbestos subject to approval of the District.
- 3) The asbestos consultant shall be chosen and approved by the District which shall have sole discretion and final determination in this matter.
- 4). The work will not be accepted until asbestos contamination is reduced to levels deemed acceptable by the asbestos consultant.

c. Hold Harmless

- 1). Interface of work under this contract with work containing asbestos shall be executed by the ESCO at ESCO’s risk and at ESCO’s discretion with full knowledge of the currently accepted standards, hazards, risks and liabilities associated with asbestos work and asbestos containing products. By execution of this contract the ESCO acknowledges the above and agrees to hold harmless, as set forth in the indemnity provisions of this Contract, the Owner, its employees, agents and assigns for all asbestos liability which may be associated with this work and agrees to instruct ESCO’s employees and agents with respect to the above-mentioned standards, hazards, risks and liabilities.
- 2). The ESCO shall, prior to commencement of this work, provide a duly signed and notarized affidavit that ESCO has instructed ESCO’s employees and agents with respect to the above-mentioned standards, hazards, risks and liabilities and the contents and requirements of this portion of the Contract Documents.

d. Certification

The ESCO agrees that materials containing asbestos or other hazardous materials as defined in Federal and State law shall not be used in construction.

17. TEMPORARY FACILITIES

- a. The ESCO shall obtain permits for, install and maintain in safe condition all scaffolds, hoisting equipment, barricades, walkways, or other temporary structures that may be required to accomplish the work. Such structures shall be adequate for the intended use and capable of safely accepting all loads that may be imposed upon them. They shall be installed and maintained in accordance with all applicable codes and regulations.
- b. The ESCO shall provide and maintain temporary heat from an approved source whenever in the course of the work it may become necessary for curing, drying or warming spaces as may be required for the proper installation of materials or finishes. The ESCO shall provide and maintain any and all facilities that may be required for dewatering in order that work may proceed on the project. If it is necessary for dewatering to occur continually, the ESCO shall have on hand whatever spare parts or equipment that may be required to avoid interruption of service or work.
- c. The ESCO shall promptly remove all such temporary facilities when they are no longer needed for the work or on completion of the project. The ESCO shall repair any damage to premises or property which resulted from the construction, use, or removal of temporary facilities and shall restore the premises and property to their original condition.

RFQ/RFP For Solar Photovoltaic System

d. See the Supplemental General Conditions and/or specifications for requirements concerning temporary sanitary facilities and utilities.

18. SIGNS

No signs may be displayed on or about the District's property (except those which may be required by law) without the District's prior written approval of size, content and location. Any signs required by the District will be designated in the Supplemental General Conditions.

19. TIME

a. The ESCO shall commence the work on the date indicated in the Notice to Proceed. Time is of the essence regarding the Contract work, and the ESCO shall prosecute the work diligently and regularly at such a rate of progress as to ensure completion of this Project within, or sooner than, the time specified.

b. The ESCOs and Subcontractors shall investigate and become aware of the amount of time required for the delivery of all equipment and materials required to perform the work under this Contract, and no extension of time shall be granted due to failure to order the equipment and materials sufficiently before their incorporation into the work so as to avoid delay to the Project.

c. The ESCO and Subcontractors shall provide and maintain enough manpower, materials and equipment to ensure a rate of construction progress that will complete the Project within or sooner than the time specified and according to the schedule of work. If, in the District's opinion, the ESCO and/or Subcontractors are not prosecuting the work at a sufficient rate of progress to meet the Project schedule, the District may direct the ESCO to provide additional manpower, materials or equipment, or to work additional hours, holidays or weekends without additional cost to the District until the work is progressing in a manner satisfactory to the District. Failure to prosecute the work in a timely manner according to the Project schedule is considered a breach of Contract and shall be cause for termination of the Contract.

20. PRE-CONSTRUCTION & CONSTRUCTION SCHEDULE

a. Within fifteen (15) calendar days after the Notice of Award of Contract, the ESCO shall prepare and submit to the Project Manager and District an electronic version of the as planned construction schedule showing in detail how the ESCO plans to prosecute the work within the time set for Final Completion. The schedule shall include the work of all trades necessary for construction of the Project and shall be sufficiently complete and comprehensive to enable progress to be monitored on a day-by-day basis. The information for each activity shall include at a minimum the activity description, duration, start date and completion date.

b. The ESCO shall take care in the preparation of the schedule to ensure that it represents an accurate and efficient plan for accomplishing the work. If the Project is more than one week behind schedule, it must be promptly revised showing how the ESCO plans to complete the work, but in no case shall it show a completion date later than that required by the Contract, unless a time extension has been granted. The current schedule shall be kept posted in the ESCO's project office on site.

c. The ESCO shall be responsible for the coordination of all work necessary and pertaining to the construction whether actually a part of this Contract or attendant thereto. The ESCO shall notify the District and various utility companies, as far as possible in advance of their required work, in order that work schedules may be developed for all concerned, which will permit the most effective and timely accomplishment of the entire project.

RFQ/RFP For Solar Photovoltaic System

21. DELAYS AND TIME EXTENSIONS

a. The ESCO may be granted a time extension if the ESCO encounters an unavoidable delay of the work due to causes completely beyond the ESCO's control and which the ESCO could not have avoided by the exercise of reasonable care, prudence, foresight and diligence. Causes for which a claim for extension of time may be made include acts of the public enemy, acts of another ESCO in the performance of another contract with the District, priority of a governmental agency for materials or equipment, fire, flood, violent windstorm, epidemic, quarantine restriction, strike, freight embargo, or weather of an unusually severe nature. The ESCO will not be granted time extensions for weather conditions which are normal for the location of the Project, according to the U. S. Weather Bureau Records.

b. A request for extension of time and compensation related thereto shall be made in writing to the Project Manager and District within ten (10) calendar days of the date the delay is encountered or shall be deemed waived. The request shall include a detailed description of the reasons for the delay and corrective measures by the ESCO. The request shall be accompanied by evidence that the insurance policies required by the Contract shall be in effect during the requested additional period of time. In order for the Project Manager to consider a request for time extension, the ESCO must prove that the reasons stated for the delay actually caused a delay in portions of the work which will result in completion beyond the date specified in the Contract. The ESCO may also be granted a time extension for a significant change in the scope of work which request for extension of time shall be included in a Contract modification proposal.

c. No damages or compensation or any kind shall be paid to an ESCO because of delays in the progress of work, whether such delays be avoidable or unavoidable, that are not the responsibility of District. District's liability to ESCO for delays for which District is responsible shall be limited to an extension of time unless such delays were unreasonable under the circumstances involved and were not within the contemplation of the parties when the Contract was awarded. The ESCO shall provide to the District the actual, substantiated costs to ESCO for which the ESCO may claim damages from District. Such costs, if any, shall be directly related to the Project, and shall not include costs that would be borne by the ESCO in the regular course of business, including, but not limited to, office overhead and ongoing insurance costs. Delay damages shall not include ESCO or Subcontractor markup for overhead and profit, but only actual, documented, and direct actual costs. The District shall not be liable for any damages which the ESCO could have avoided by any reasonable means including, but not limited to, the more judicious handling of forces or equipment.

d. The granting of an extension of time because of unavoidable delays shall in no way operate as a waiver on the part of the District of the right to collect liquidated damages for other delays or of any other rights to which the District is entitled.

22. LIQUIDATED DAMAGES

a. Should the ESCO fail to achieve Final Completion of this Contract within the time fixed for Final Completion, together with extensions granted by the District for unavoidable delays, ESCO shall become liable to the District in the amount specified in the Contract per calendar day for each day the Contract remains incomplete beyond the time for Final Completion, as liquidated damages and not as a penalty. ESCO may also be assessed liquidated damages for failure to meet milestones specified in the Contract Documents, regardless of impact on overall Project completion. ESCO shall not be charged with liquidated damages when the delay in completion of the work beyond the time for Final Completion is due to acts of the District. It is expressly stipulated and agreed by ESCO and District that it would be impractical and extremely difficult to fix the actual amount of damages.

RFQ/RFP For Solar Photovoltaic System

- b. In addition to any liquidated damages which may be assessed, if ESCO fails to achieve Final Completion of this Contract within the time fixed for Final Completion, together with extensions granted by the District for unavoidable delays, and if as a result District finds it necessary to incur any costs and/or expenses, or if District receives any claims by other contractors, subcontractors, or third parties claiming time or other compensation by reason of ESCO's failure to complete work on time, ESCO shall pay all those costs and expenses incurred by District. These costs and expenses may include but are not limited to such items as rental payments, inspection fees, and additional architectural fees, whether related to the acquisition of facilities or caused by the delay in completion.
- c. Any money due or to become due the ESCO may be retained to cover liquidated damages. Should such money not be sufficient to cover the liquidated damages, the District shall have the right to recover the balance from the ESCO or ESCO's sureties.
- d. Should the District authorize suspension of the work for any cause, the time work is suspended will be added to the time for completion. Suspension of the work by the District shall not be a waiver of the right to claim liquidated damages as set forth in this section.
- e. The assessment of Liquidated Damages does not otherwise limit the right of the Owner to claim a loss or damages incurred by the Owner for reasons other than delay (e.g. damages due to defective work).

23. DISTRICT'S RIGHT TO STOP WORK; TERMINATION OR SUSPENSION OF THE CONTRACT

a. District's Right to Stop Work:

In addition to or as an alternative to any and all other remedies available to the District, if the ESCO fails to correct work which is not performed in accordance with the Contract Documents, or if the ESCO persistently fails to perform the work in accordance with the Contract Documents, the District may by written order direct the ESCO to stop the work, or any portion thereof, until the cause for such order has been eliminated to the satisfaction of the District. However, the right of the District to stop the work shall not give rise to a duty on the part of the District to exercise this right for the benefit of the ESCO or any other person or entity, and the failure of the District to do so shall not be raised as a defense to the ESCO's failure to perform the work in accordance with the Contract Documents.

b. Termination for Cause:

- 1). If the ESCO refuses or fails to furnish sufficient materials, work force, equipment, and appurtenances to properly prosecute the work in a timely manner, or if ESCO refuses or fails to comply with any provisions of the Contract Documents, or if ESCO should file a bankruptcy petition or make a general assignment for the benefit of ESCO's creditors or if a receiver should be appointed on account of ESCO's insolvency, then the District may give the ESCO and ESCO's Surety written notice of intention to terminate the Contract. Unless within seven (7) calendar days after the serving of such notice upon the ESCO and ESCO's Surety such violation shall cease and arrangements for correction of such conditions shall be made satisfactory to the District, the Contract shall cease and terminate. In the event of such termination, the District shall immediately serve written notice thereof upon the ESCO and ESCO's Surety.
- 2). In the event of termination for cause, in addition to all remedies available to the District, the ESCO's Surety shall have the right to take over and perform the Contract; provided, however, that if the Surety does not commence performance within five (5) calendar days from the date of

RFQ/RFP For Solar Photovoltaic System

the issuance of such notice of termination, the District may take over the work and prosecute the same to completion by letting another Contract, or by any other method that the District deems advisable. The ESCO and ESCO's Surety shall be liable for any excess cost incurred by the District thereby, and in any such event the District may take possession of such materials, equipment, and other property belonging to the ESCO as may be on the site and use same in completing the work.

c. **Termination or Suspension for Convenience:**

The District reserves the right, in its sole discretion, to terminate or suspend all or part of the Contract for convenience following three (3) days written notice to the ESCO. In the event of termination or suspension for convenience, ESCO shall have no claims against the District, except:

- 1). The actual cost of labor, materials and services provided pursuant to the Contract, and which have not yet been paid for, as documented by timesheets, invoices, receipts and the like; and
- 2). Five percent (5%) of the total cost of the work performed as of the date of notice of termination or suspension or five percent (5%) of the value of the work yet to be completed, whichever is less. The parties agree that this amount shall constitute full and fair compensation for all ESCO's lost profits and other damages resulting from the termination or suspension for convenience.

24. ASSIGNMENT OF CONTRACT

The ESCO may not assign or delegate all or any portion of this Contract without the written consent of the District and no such consent shall be given which would relieve the ESCO or its Surety of their responsibilities under the Contract. The ESCO may assign, without liability to the District, monies due the ESCO under the Contract to banks, trust companies or other financial institutions provided written notice thereof is promptly delivered to the District. Assignment of monies earned by the ESCO shall be subject to the same retention as other payments made to ESCO and shall also be subject to setoffs and back charges as provided by this Contract.

25. COORDINATION WITH OTHER CONTRACTS

a. The District reserves the right to do other work or award other contracts in connection with this Project. By entering into this Contract, ESCO acknowledges that there may be other ESCOs on or adjacent to the Project site whose work must be coordinated with that of its own. ESCO expressly warrants and agrees that it will cooperate with other ESCOs and will do nothing to delay, hinder, or interfere with the work of other ESCOs, or that of the District, its Project Manager and Construction Manager. ESCO also expressly agrees that in the event its work is hindered, delayed, interfered with, or otherwise affected by a separate ESCO, its sole remedy will be a direct action against the separate ESCO. To the extent allowed by law, the ESCO expressly waives any remedy against the District, its Project Manager and Construction Manager on account of delay, hindrance, interference or other such events caused by a separate ESCO.

b. If any part of ESCO's work depends upon the work of a separate ESCO, ESCO shall inspect such other work and promptly report in writing to the District and Project Manager any defects in such other work that render it unsuitable to receive the work of ESCO. Failure of the ESCO to so inspect and report shall constitute an acceptance of the other ESCO's work, except as to defects which the ESCO could not have detected through the reasonable inspection of the other ESCO's work prior to the execution of ESCO's work.

RFQ/RFP For Solar Photovoltaic System

- c. If ESCO is aware of a current or potential conflict between ESCO's work and the work of another ESCO on the site and is unable to informally resolve the conflict directly with the other ESCO, ESCO shall promptly provide written notice to the District, with a copy to the Project Manager and the other ESCO, specifying the nature of the conflict, the date upon which the conflict arose, and the steps taken to attempt to resolve the conflict. The District may issue written instructions to address the conflict.
- d. If, through ESCO's negligence, any other ESCO or Subcontractor shall suffer loss or damage to the work, ESCO shall make a reasonable effort to settle with such other ESCO and Subcontractor by agreement or arbitration. If such other ESCO or Subcontractor shall assert any claim against the District or Project Manager, on account of any damage alleged to have been so sustained, the District or Project Manager shall notify the ESCO, who shall defend such proceedings at ESCO's own expense and save harmless and indemnify the District and the Project Manager from any such claim.

26. SUBMITTALS: SHOP DRAWINGS, CUTS AND SAMPLES

- a. Within fifteen (15) calendar days after the award of the Contract, the ESCO shall prepare and submit to the Project Manager and School an electronic copy of shop drawings, brochures and cut sheets and samples in quantities specified by the Project Manager shall be submitted to the Project Manager for all items for which they are required by the plans and specifications. Prior to transmittal, the ESCO shall examine all submittals for accuracy and completeness in order to verify their suitability for the work and compliance with the Contract Documents and shall sign and date each submittal. Submittals shall be sent for review sufficiently before the items are required for the work so as to cause no delay and shall be in accordance with the project construction schedule.
- b. In addition to information furnished as common practice, submittals shall contain the Project name and location, ESCO's name and address, Subcontractor's or supplier's name and address, date of submittal and any revisions, and reference to appropriate specification section, and/or drawing and detail numbers. The ESCO and/or the Subcontractors shall verify in the field all dimensions and relationships to adjacent work necessary to ensure the proper fit of the items submitted. If necessary, the ESCO shall make any corrections required and resubmit with all due haste in the same number as initially required.
- c. Review of submittals, shop drawings, cuts or samples by the District or Project Manager shall not relieve the ESCO from complying with the requirements of the Contract Documents.
- d. Any materials or equipment installed without approval shall be at the ESCO's own risk, and ESCO may be required to remove any such materials or equipment and install the specified items at ESCO's own cost, including repairs to adjacent work.

27. PAYMENTS

- a. Cost Breakdown:

Within 15 calendar days after receipt of the Notice to Proceed, the ESCO shall prepare and submit to the Project Manager and District a cost breakdown (schedule of values) showing the major work items for each trade or operation required in construction of the Project. The work items shall be sufficiently detailed to enable the Project Manager to accurately evaluate the completion percentages requested by the ESCO. The cost for each work item shall include overhead and profit. The total of all work item costs shall equal the amount of the Contract.

RFQ/RFP For Solar Photovoltaic System

b. Scope of Payment:

Payment to the ESCO at the unit price or other price fixed in the Contract for performing the work required under any item or at the lump sum price fixed in the Contract for performing all the work required under the Contract, shall be full compensation for furnishing all labor, materials, equipment and tools necessary to the work, and for performing and completing, in accordance with the Specifications, all work required under the item or under the Contract, and for all expense incurred by the ESCO for any purpose in connection with the performance and completion of the work.

c. Progress Payments:

The ESCO will, on or about the 25th day of each month, make an estimate of the value of the work completed by ESCO in the performance of the Contract. These estimates shall be subject to the review and approval of the Project Manager. The first such estimate will be of the value of the work completed after the ESCO commenced the performance of the Contract, and every subsequent estimate, except the final estimate, will be of the value of the work completed since the immediately preceding estimate. Such estimates will be based on labor, materials and equipment incorporated into the work, and items of materials and equipment delivered to the Project. The ESCO shall be responsible for the security and protection of such materials and equipment delivered to the Project and not incorporated in the work. The Governing Board has found that the Project is substantially complex and therefore requires a retention amount of 10%. Within thirty (30) calendar days after the approval of each estimate for progress payment, the District will pay to the ESCO an amount equal to ninety (90) percent of the approved estimate. Payments may at any time be withheld if in the judgment of the District the work is not proceeding in accordance with the Contract Documents, the ESCO is not complying with the requirements of the Contract, stop notices have been timely filed, the estimate contains an error, or the District has incurred costs or requests reasonable financial assurances regarding defective work by the ESCO.

d. Final Payment:

Within thirty (30) days after all required work is fully completed in accordance with the Contract Documents, the ESCO shall submit a final invoice for the total value of the work completed in accordance with the Contract, which shall be subject to review and approval by the District. As required by law, District shall pay ESCO the unpaid balance of the Contract price of the work, or the whole Contract price of the work if no progress payment has been made, determined in accordance with the terms of the Contract, less such sums as may be lawfully retained under any provision of the Contract, including, but not limited to, amounts retained as liquidated damages, for stop notices, for third-party claims for which the ESCO is required to indemnify the District, for defective work and costs incurred by the District in connection therewith, or for other such claims and damages attributable to the ESCO ("Final Payment"). Prior progress estimates and payments are subject to correction in the Final Payment. Tender of the Final Payment shall constitute denial by the District of any unresolved claim. ESCO's acceptance of the Final Payment shall operate as a full and final release to the District and its agents from any and all unasserted claims ESCO has, or may have, related to this Contract.

e. Payments Do Not Imply Acceptance of Work:

The granting of any progress payment or payments by the District or the receipt thereof by the ESCO shall not constitute acceptance of the work or of any portion thereof and shall in no way lessen the liability of the ESCO to replace unsatisfactory work or material, whether or not the unsatisfactory character of such work or material was apparent or detected at the time such payment was made.

RFQ/RFP For Solar Photovoltaic System

f. Retention of Sums Charged Against ESCO:

It is mutually understood and agreed that when under any provision of this Contract the District shall charge any sums of money against the ESCO, the amount of such charge shall be deducted and retained by the District from the amount of the next succeeding progress estimate, or from any other monies due or that may become due the ESCO on account of the Contract. If on completion or termination of the Contract such monies due the ESCO are found insufficient to cover the District's charges against the ESCO, the District shall have the right to recover the balance from the ESCO or the ESCO's Sureties.

g. Release:

The ESCO and each assignee under an assignment in effect at the time of Final Payment shall, if required by the District, execute and deliver at the time of Final Payment and as a condition precedent to Final Payment, a release in form and substance satisfactory to and containing such exemptions as may be found appropriate by the District, discharging the District, its officers, agents and employees of and from liabilities, obligations and claims arising under this Contract.

h. Payment to Subcontractors and Suppliers:

The ESCO shall pay each Subcontractor and supplier promptly on receipt of each progress payment from the District for the materials, labor and equipment delivered to the site or incorporated in the work by each Subcontractor during the period for which the progress payment is made, less any retention as provided above.

i. Stop Notice Costs:

The District reserves the right to charge the ESCO or Surety, or to withhold from release of retention, all costs incurred by the District, including attorney's fees, for processing and defending stop notice claims.

28. MODIFICATIONS OF CONTRACT

a. Changes in the Work:

- 1). The District, before the date of acceptance of the work, may, without notice to the Sureties, order changes in the work ("Modifications"), may order extra materials and extra work in connection with the performance of the Contract, and the ESCO shall promptly comply with such orders. All Modifications must be approved by DSA and the State Fire Marshall, if applicable, as required by law.
- 2). If changes ordered in design, workmanship or materials are of such a nature as to increase or decrease the cost of any part of the work, the price fixed in the Contract shall be increased or decreased by such amount as represents the reasonable and proper allowance for the increase or decrease in the cost of the work in accordance with the provisions of this Article, and any other applicable terms of the Contract, including, but not limited to, the ESCO's schedule of values and the price for allowances, if any. Except as provided by law, the **total cost of all Modifications shall not exceed ten (10) percent of the original Contract price.**
- 3). In the case of a disputed work item, the District may direct the ESCO to perform the disputed work at no additional cost to the District on the grounds that the work is adequately indicated in the Contract Documents, and therefore already included in the Contract price. If the ESCO maintains that the disputed work represents a modification to the Contract, ESCO may submit a claim in accordance with Article 50, Resolution of Construction Claims. Notwithstanding any

RFQ/RFP For Solar Photovoltaic System

dispute regarding the requirements of the Contract Documents, ESCO shall promptly and fully comply with the District's directive. ESCO's failure to do so shall be deemed a material breach of this Contract, and in addition to all other remedies, District may, at its sole discretion, hire another ESCO and/or use its own forces to complete the disputed work at ESCO's sole expense, and may deduct the cost of such work from the Contract price.

b. Cost Breakdown

When the Modification is proposed, the ESCO shall furnish a complete breakdown of actual costs of both credits and extras, itemizing materials, labor, taxes, overhead and profit. Subcontract work shall be so indicated. All costs must be fully documented. The following limitations shall apply:

1). Limitations Where Contract Price Changes are Involved:

- (a) Overhead and Profit for the ESCO. The ESCO's overhead and profit on the cost of subcontracts shall be a sum not exceeding ten percent (10%) of such costs. The ESCO's overhead and profit on the costs of work performed by the ESCO shall be a sum not exceeding fifteen percent (15%) of such costs. Overhead and profit shall not be applied to the cost of taxes and insurance by ESCO or Subcontractors or to credits. No processing or similar fees may be charged by the ESCO in connection with the Modification.
- (b) Bond Premiums. The actual rate of bond premiums as paid on the total cost (including taxes) will be allowed, but with *no markup for profit and overhead.*
- (c) Taxes. State and city sales taxes should be indicated. Federal excise tax shall not be included. (District will issue an exemption on request.)

2). Change Order Certification:

All change orders and requests for proposed change orders shall be deemed to include the following certification by the ESCO:

"The undersigned ESCO approves the foregoing as to the changes in work, if any, and as to the Contract price specified for each item and as to the extension of time allowed, if any, for completion of the Project as stated herein, and agrees to furnish all labor, materials, and service and to perform all work necessary to complete any additional work specified for the consideration stated herein. Submission of claims which have no basis in fact or which ESCO knows are false are made at the sole risk of the ESCO and may be a violation of the False Claims Act, as set forth in Government Code §§12650 et seq. It is understood that the changes to the Contract Documents set forth herein shall only be effective upon approval by the Governing Board of the District."

"It is expressly understood that the value of the extra work or changes expressly includes any and all of the ESCO's costs and expenses, both direct and indirect, resulting from additional time required on the Project or resulting from delay to the Project. Any costs, expenses, damages, or time extensions not included herein are deemed waived."

c. Unit Prices, Schedule of Values, or Allowances:

Where Unit Prices, a Schedule of Values, and/or Allowances are required by the Contract Documents, that pricing shall govern in computing any additions to or deductions from the Contract price on account of any added or omitted work. Unit Prices listed in the original proposal include all costs and no addition of any description will be allowed.

RFQ/RFP For Solar Photovoltaic System

d. Time and Materials:

If it is impractical, because of the nature of the work, or for any other reason, to fix an increase in price in advance, the Change Order may fix a maximum price which shall not under any circumstances be exceeded, and subject to such limitation, such alteration, modification or extra shall be paid for at the actual necessary cost as determined by the sum of the following items (1) to (5) inclusive:

- 1). Labor, including premium on compensation insurance and charge for Social Security taxes, and other taxes pertaining to labor.
- 2). Material, including sales taxes and other taxes pertaining to materials.
- 3). Plant and equipment rental, to be agreed upon in writing before the work is begun. No charge for the cost of repairs to plant or equipment will be allowed.
- 4). Overhead and profit computed at fifteen percent (15%) of the total of Items (1) to (3) inclusive.
- 5). The proportionate cost of premiums on bonds computed at one and one-half percent (1-1/2%) of the total of items (1) to (4) inclusive.

If the Time and Materials work is done by a Subcontractor, the amount shall be determined as set forth above under items (1) to (5) inclusive. The ESCO's overhead and profit on the costs of subcontracts (exclusive of taxes and insurance) shall not exceed ten percent (10%) of such costs.

The District reserves the right to furnish such materials as it may deem expedient, and no allowance will be made for profit thereon. The above-described methods of determining the payment for work and materials shall not apply to the performance of any work or the furnishing of any material which, in the judgment of the District, may properly be classified under items for which prices are established in the Contract.

e. Oral Modifications:

No oral statements of any person shall in any manner or degree modify or otherwise affect the terms of the Contract.

29. INDEMNITY

ESCO shall defend with counsel acceptable to the District, indemnify and hold harmless to the full extent permitted by law, the District and its Board of Trustees, officers, agents, Project Manager, construction manager, employees and volunteers from and against any and all liability, loss, damage, claims, expenses, fines, judgments and costs (including, without limitation, attorney's fees and costs and fees of litigation) (collectively, "Liability") of every nature arising out of or in connection with ESCO's performance of the Project or its failure to comply with any of its obligations contained in these Contract Documents, except such Liability caused by the active negligence, sole negligence or willful misconduct of the District. Such indemnification shall extend to all claims, demands, or liabilities occurring after completion of the project as well as during the progress of the work. Pursuant to Public Contract Code §9201, District shall timely notify ESCO of receipt of any third-party claim relating to this Project.

RFQ/RFP For Solar Photovoltaic System

30. WARRANTY OF TITLE

ESCO warrants that title to all work, materials or equipment included in a request for payment shall pass and transfer to the District whether or not they are installed or incorporated in the Project, free from any claims, liens or encumbrances, when such payment is made to the ESCO. ESCO further warrants that no such work, materials or equipment have been purchased for work under the Contract subject to an agreement by which an interest therein or an encumbrance thereon is retained by the seller or supplier.

31. USE OF COMPLETED PARTS OF THE WORK BEFORE ACCEPTANCE

Whenever the work or any part thereof is in a condition suitable for use, and the best interest of the District requires such use, as determined by the District, the District may take possession of, connect to, open for public use, or use the work or a part thereof. When so used, maintenance and repairs due to ordinary wear and tear or vandalism will be made at District's expense. The use by the District of the work or part thereof as contemplated in this section shall in no case be construed as constituting acceptance of the work or any part thereof, including, but not limited to, the right to assess liquidated damages. Such use shall neither relieve the ESCO of any of ESCO's responsibilities under the Contract nor act as a waiver by the District of any of the conditions thereof. ESCO shall continue to maintain all insurance, including Builder's Risk insurance, on the entire Project, and diligently pursue full completion of the work.

32. GUARANTEE & WARRANTY

a. By signing this Contract, ESCO agrees to the following guarantee and warranty:

We hereby guarantee and warrant our work on the ECAA-Ed Energy Project for a period of ten (10) years from the date of filing of the Notice of Completion.

Panels will have a 25-year warranty.

Inverters shall have the maximum extended warranty.

ESCO shall promptly repair or replace to the satisfaction of the District any or all work that appears defective in workmanship, equipment and/or materials for whatever reason, ordinary wear and tear and unusual abuse or neglect excepted, together with any other work which may be damaged or displaced in so doing. ESCO agrees to promptly correct and remedy any failure by the ESCO to conform its work, activities and services to the requirements of the Contract Documents.

ESCO shall provide post-construction a 10% warranty bond substantially in form of **Appendix F**, attached hereto for any work that may need repair or replacement post-installation for a period of two years from the date of filing the Notice of Completion or ESCO can provide a two-year maintenance period from the Payment and Performance bonds from the date of filing the Notice of Completion. Warranty bond shall be issued before substantial completion of project.

In the event of the ESCO's failure to comply with the above-mentioned obligations within the ten (10) calendar days of notice, or sooner if required by an emergency, ESCO hereby authorizes the District to have the defects or deficiencies repaired, remedied, corrected and made good at ESCO's expense, and ESCO shall pay the costs and charges therefore upon demand. The warranty bond will cover these costs and charges as well for a period of two years from the date of filing the Notice of Completion.

RFQ/RFP For Solar Photovoltaic System

33. PROTECTION OF WORK AND PROPERTY

a. The ESCO shall be responsible for each operation and all work on the Project, both permanent and temporary. The ESCO shall protect the work and materials from damage due to negligence, the action of the elements, the carelessness of third parties, vandalism, or any other cause whatsoever, until the final completion and acceptance of the Project. Should improper work by the ESCO be covered by another ESCO and damage or defects result, the whole work affected shall be made good by the ESCO to the satisfaction of the Project Manager and District without expense to the District. The ESCO shall take reasonable care to avoid damage to existing facilities or utilities, whether on the Project or adjacent to it, and ESCO shall be liable for any damage thereto or interruption of service due to ESCO's operations. If the ESCO encounters any facilities or utilities not shown on the drawings or not reasonably inferable there from, ESCO shall promptly notify the Project Manager about them, and shall do no further work which may cause damage to same. If it is determined that some action needs to be taken regarding facilities not shown, the ESCO will be given directives on what action to take, and any additional cost to the ESCO incurred thereby will be handled by Change Order.

b. The property limits of the area of the Project are indicated on the drawings. Except for work specifically shown or noted, ESCO shall confine ESCO's operations within the indicated property limits. The ESCO shall provide, install, and maintain all shoring, bracing and underpinning necessary to support adjacent property, streets, buildings and structures, that may be affected by building operations for this work; shall serve or cause to be served all legal notices to adjoining property owners that may be necessary for their protection; and shall protect from damage all adjacent buildings, fences, landscaping, and repair or replace any such property damaged in the course of work under the Contract.

34. USE OF ROADWAYS AND WALKWAYS

The ESCO shall not unnecessarily interfere with use of any roadway, walkway or other facility for vehicular or pedestrian traffic, by any party entitled to use it. Wherever such interference becomes necessary for the proper and convenient performance of the work and no satisfactory detour route exists, the ESCO shall, before beginning the interference, provide a satisfactory detour, temporary bridge, or other proper facility for traffic to pass around or over the interference and shall maintain it in satisfactory condition as long as the interference continues, all without extra payment unless otherwise expressly stipulated in the Contract Documents.

35. MATERIALS

a. Unless explicitly stated otherwise, all specified equipment and material comprising the work of this Contract, as being provided or furnished or installed, shall imply the inclusion of all components, hardware and accessories, required for complete installation and satisfactory operation as intended by the manufacturer. Wherever the method of installation of any material is not explicitly specified, the installation shall be as recommended by manufacturer.

b. Wherever in the Contract Documents it is provided that the ESCO shall furnish materials or equipment for which no detailed specifications are set forth, such materials or equipment shall be new and of the best grade for the purpose for which they will be used when incorporated in the work. Materials specified by reference to a number or symbol of a specific standard, such as A.S.M., Federal Specification, State Standard, Trade Association, or similar standards, shall comply with requirements in the latest revision thereof and any amendment or supplement in effect on the date of the Request for Proposals.

RFQ/RFP For Solar Photovoltaic System

c. None of the materials to be provided furnished or installed on this project shall contain asbestos or any other "hazardous substance" as that term is defined by federal or state law.

36. SUBSTITUTIONS

a. Wherever in the drawings or Specifications a material or product is called for by trade or brand names or manufacturer and model number, alternative items of equal quality and purpose may be proposed for use by the ESCO. The burden of proof of equality is on the ESCO, and ESCO shall furnish all information and supplies necessary for the Project Manager to make a thorough evaluation of the proposed substitution. The Project Manager's decision about the equality of the proposed substitution is final, and if the proposed substitution is not approved, the ESCO shall install the item called for. Proposed substitutions and any changes in adjacent work caused by them shall be made by the ESCO at no additional cost to the District.

b. Proposed substitutions shall be submitted sufficiently before actual need to allow time for thorough evaluation. Substitutions shall not be proposed because submittals were not made early enough to avoid delay. Project Manager's review of substitutions shall not relieve the ESCO from complying with the requirements of the drawings and Specifications. Requests for substitution will be considered if received within 30 days after receipt of the Notice of Award. Requests received more than 30 days after receipt of the Notice of Award may be considered or rejected at the discretion of the Project Manager. ESCO shall identify the product, or the fabrication or installation method to be replaced in the request. ESCO shall also provide complete documentation showing compliance with the requirements for substitutions, as set forth herein, and the following information, as appropriate:

- Product Data, including Drawings and descriptions of products, fabrication and installation procedures.
- Samples, where applicable or requested.
- A detailed comparison on the same page of significant qualities of the proposed substitution with those of the Work specified. Significant qualities may include elements such as size, weight, durability, performance and visual effect. All differences in products shall be noted.
- A statement indicating the substitution's effect on the ESCO's Construction Schedule compared to the schedule without approval of the substitution. Indicate the effect of the proposed substitution on overall Contract Time.
- Certification by the ESCO that the substitution proposed complies in every significant respect to that required by the Contract Documents, and that it shall:
 - Be equal to or better in every significant respect to specified material or product and shall perform adequately in the intended application.
 - Provide the same or greater warranty for the substitution as for the specified product.
 - Provide the same required fire rating for the substitution as for the specified product.
 - Coordinate installation and make changes to other Work, which may be required for the Work to be complete with no additional costs to Owner.

RFQ/RFP For Solar Photovoltaic System

c. In the event ESCO makes substitutions in materials, equipment, or designs, with or without the District's approval, other than those authorized herein, the ESCO shall then assume full responsibility for the effects of such substitutions on the entire project, including the design, and shall reimburse the District for any charges resulting from such substitutions, including any charges for modifications in the work of other trades, and including any charges for additional design and review, plus reasonable and customary mark-ups.

37. TESTING

a. Materials, equipment, or other work requiring tests may be specified in the Contract Documents, and they shall be adequately identified and delivered to the site in ample time before intended use to allow for testing. If such materials, equipment or other work should be covered without required testing and approval, they shall be uncovered at the ESCO's expense, including any repairs or replacement resulting there from. The ESCO shall notify the District and Project Manager when and where such materials, equipment or other work are ready for testing, and ESCO shall bear the cost of making them available for testing. The ESCO shall notify the District and Project Manager sufficiently before the need for testing so as to cause no delay in the work and, in any case, at least forty-eight (48) hours prior to the need for testing.

b. The cost of initial tests called for will be paid by the District and will be performed by independent testing consultants retained by the District. All other tests and inspections specified or otherwise required to substantiate compliance with specified requirements for quality of material or performance of operation shall be paid for by the ESCO. If retesting or additional testing is necessary because of substandard initial test results, the costs thereof shall be paid by the ESCO, including any repairs or replacement resulting there from.

38. INSPECTION

a. All materials, equipment and workmanship used in the work of the Project shall be subject to inspection or testing at all times and locations during construction and/or manufacture. The District's and Project Manager's authorized representatives and representatives of other agencies having authority over the work shall have access to the work for the above purposes at all reasonable times and locations. Any material or work found to be unsatisfactory or not according to the Contract Documents shall be replaced with the correct material or work and the defective items promptly removed, all at the ESCO's expense, when directed to do so by any of the above-named persons having authority over the work. The cost of review time and analysis by the Project Manager or other District consultants necessitated by incomplete or defective work by the ESCO shall be charged to the ESCO.

b. Inspection and testing by the District or its representatives shall not relieve the ESCO from complying with the requirements of the Contract Documents. The ESCO is responsible for its own quality control.

c. Whenever required by the District or Project Manager, the ESCO shall furnish all tools, labor and materials necessary to make an examination of work in place by uncovering the same. Should such work be found unsatisfactory, the cost of examination and reconstruction shall be paid by the ESCO. Should such work be found satisfactory, the cost of examination and reconstruction of the work shall be paid by Change Order unless the ESCO improperly covered the work before it could be inspected or tested. If the ESCO considers it necessary or desirable to work on Saturday, Sunday or a holiday, ESCO shall seek written approval from the District at least forty-eight (48) hours before the commencement of such work.

RFQ/RFP For Solar Photovoltaic System

39. CLEANUP

a. The ESCO shall maintain the premises and area of the work shall be in a reasonably clean condition. No burning of rubbish on-site shall be allowed. The ESCO shall control dust on the site by sprinkling at whatever intervals are necessary to keep it laid down and shall take measures to prevent dust and debris from being accidentally transported outside the area of the work.

b. Final cleaning, such as sweeping, dusting, vacuuming, dry and wet mopping, polishing, sealing, waxing and other finish operations normally required on newly installed work shall be taken to indicate the finished conditions of the various new and existing surfaces to restore area to condition at the time of acceptance. Prior to the time of acceptance, all marks, stains, fingerprints, dust, dirt, splattered paint and blemishes resulting from the various operations shall be removed throughout the Project. Stair treads and risers shall be wet-mopped. Glass shall be left clean and polished both inside and outside. Plumbing fixtures and light fixtures shall be washed clean. Hardware and other unpainted metals shall be cleaned, and all building papers and other temporary protections shall be removed throughout the building, or portion of the building where ESCO was involved, all to the satisfaction of the Project Manager and District. The exterior of the buildings, playfields, exterior improvements, planting spaces, and other work areas shall be similarly clean and in good order.

40. CONSTRUCTION WASTE MANAGEMENT

The ESCO shall submit the Waste Management Plan to the Project Manager within 15 calendar days after receipt of the Notice to Proceed, or prior to any waste removal, whichever occurs first. The ESCO shall promptly revise and resubmit the Plan as required by the Project Manager. Review of the ESCO's Waste Management Plan will not relieve the ESCO of responsibility for compliance with applicable environmental regulations or meeting Project diversion requirements.

a. Scope

- 1). This Article includes requirements for the diversion by the ESCO of construction and demolition debris from landfills. The ESCO shall develop and implement a Waste Management Plan as specified herein. The ESCO shall take a pro-active, responsible role in the management of construction and demolition waste and require all Subcontractors, vendors, and suppliers to participate in the effort.
- 2). The District has established that this Project shall generate the least amount of waste practicable and that processes shall be utilized that ensure the generation of as little waste as possible due to over-packaging, error, poor planning, breakage, mishandling, contamination or other factors.
- 3). As much of the waste materials as economically feasible shall be reused, salvaged or recycled. Waste disposal in landfills shall be minimized.
- 4). The ESCO is encouraged to use waste hauling companies that separate recyclable materials. The ESCO shall work with its waste haulers in providing other recycling methods as appropriate.
- 5). The ESCO is responsible for implementation of any special programs involving rebates or similar incentives related to the recycling of waste. Revenues or other savings obtained for salvage or recycling accrue to the ESCO.

b. References

- 1). "Builders' Guide to Reuse and Recycling, A Directory for Construction and Demolition Materials."
- 2). "Construction Site Recycling, a Guide for Building ESCOs ". For a copy of the guide call 1-888-442-2666 or go to www.recycleworks.org.

RFQ/RFP For Solar Photovoltaic System

3). "Where to Recycle Construction and Demolition Debris." For a copy of the guide call 1-888-442-2666 or go to www.recycleworks.org.

c. Definitions

- 1). General: Construction and demolition waste includes products of demolition or removal, excess or unusable construction materials, packaging materials for construction products, and other materials generated during the construction process but not incorporated into the work.
- 2). Divert" means to use material for any lawful purpose other than disposal in a landfill or transfer facility for disposal
- 3). "Recycling Service" means an off-site service that provides processing of material and diversion from a landfill.
- 4). "Hauler" means the entity that transports construction and demolition debris to either a landfill or a recycling service.

d. Compliance with Regulatory Requirements

- 1). The ESCO shall perform all handling, storage, transportation and disposal of construction debris in compliance with all applicable Federal, State, regional, and local statutes, laws, regulations, rules, ordinance, codes and standards.
- 2). Nothing stated on the drawings, in this Article 40 or in any other provision of the Contract Documents shall be construed as allowing work that is not in strict compliance with all applicable Federal, State, regional, and local statutes, laws, regulations, rules, ordinances, codes and standards.

e. Performance Requirement

The ESCO shall divert a minimum of 50 percent (50%) of the total Project construction and demolition waste from landfills.

f. Quality Control

- 1). General:
 - i) The ESCO shall not permit materials designated for diversion to become contaminated or to contaminate the site or surrounding areas.
- 2). Training and Coordination:
 - i) The ESCO shall designate an on-site party [or parties] who will be responsible for instructing workers and Subcontractors and overseeing and documenting the results of the Waste Management Plan for the Project.
 - ii) The ESCO shall furnish copies of the Waste Management Plan to all on-site supervisors, each Subcontractor, and the District's representative.
 - iii) The ESCO shall include construction waste management as an item on the agenda of all progress meetings.
- 3). The Waste Management Plan:
 - i) The ESCO shall prepare a Waste Management Plan for diverting the specified percentage of construction debris from landfills, including written and graphic information indicating how the waste will be diverted.
 - ii) Include in the plan both on-site recycling of construction debris and off-site diversion from landfills.
 - iii) Identify the means and methods for collecting and separating each type of debris deemed reusable or recyclable.
 - iv) List the off-site recycling service and hauler of each designated debris item who has agreed to accept and divert that item from the landfill in the proposed quantities anticipated. List the service and hauler company name, address, telephone number, and persons contacted.

RFQ/RFP For Solar Photovoltaic System

- v) List the name of individuals on the ESCO's staff responsible for waste prevention and management.
 - vi) List the actions that will be taken to reduce solid waste generation, including coordination with Subcontractors to ensure awareness and participation.
 - vii) Describe the specific approaches to be used in recycling/reuse of the various materials generated, including the areas on site and equipment to be used for processing, sorting, and temporary storage of wastes.
 - viii) Characterize the waste to be generated, including estimated types and quantities. Name the landfills and/or incinerator to be used.
 - ix) List the specific waste materials that will be salvaged for resale, salvaged and reused on the Project, salvaged and stored for reuse on a future project, or recycled. Recycling facilities that will be used shall be identified by name, location, and phone number.
 - x) Identify the materials that cannot be recycled or reused with an explanation or justification, to be approved by the Project Manager.
- g. Plan Implementation
- 1). The ESCO shall implement the approved Waste Management Plan.
 - 2). The ESCO shall maintain a log of each load and of each category of waste that is diverted from the landfill. The ESCO shall separately log the debris sent to a Class III landfill and materials sent to recycling facilities.
 - 3). The ESCO shall include in the log the type of load, load weight, name of the hauling service, recycling service or landfill, and the date accepted by the recycling service or by the landfill.
 - 4). The ESCO shall retain and make available all weight tickets and copies of receipts and invoices relating to the implementation of the Plan.
 - 5). The District reserves the right to audit the log at any time.
- h. Material Handling
- 1). Designate a specific area or areas on site to facilitate the separation of materials for potential reuse, salvage, recycling, and return. Clearly mark bins for each category of waste.
 - 2). Keep waste bins and pile areas neat and clean. Do not contaminate non-recyclable waste with materials designated for reuse or recycling.
- i. ESCO's Responsibilities
- 1). Provide on-site instruction of the appropriate separation, handling, recycling, salvage, reuse, and return methods to be used by all parties at the appropriate stages of the Project.
 - 2). Separate, store, protect, and handle at the site identified recyclable and salvageable waste products in a manner that maximizes recyclability and salvageability of identified materials.
 - 3) Provide the necessary containers, bins and storage areas to facilitate effective waste management.
 - 4) Provide barriers and enclosures around recyclable material storage areas which are nonhazardous and recyclable or reusable and which shall be located away from construction traffic.
 - 5) Provide adequate space for pick-up and delivery.
 - 6) Use cleaning materials that are nonhazardous and biodegradable.

41. INSTRUCTIONS AND MANUALS

ESCO will provide one electronic copy of all maintenance instructions application/installation instructions and service manuals called for in the Specifications shall be provided by the ESCO to the Project Manager for the project record. These shall be complete as to drawings, details, parts lists, performance data and other information that may be required for the District to easily maintain and

RFQ/RFP For Solar Photovoltaic System

service the materials and equipment installed under this Contract. All manufacturers' application/installation instructions shall be given to the Project Manager at least ten (10) days prior to first material application or installation of the item. The maintenance instructions and manuals, along with any specified guarantees, shall be delivered to the Project Manager for review prior to submitting to District, and the ESCO or appropriate Subcontractors shall instruct District's personnel in the operation and maintenance of the equipment prior to final acceptance of the Project. All documentation must be received by Project Manager within thirty (30) calendar days after District's Notice of Completion.

42. AS-BUILT DRAWINGS

The ESCO and all Subcontractors shall maintain on the work site a separate complete set of contract drawings which will be used solely for the purpose of recording changes made in any portion of the work during the course of construction, regardless of the reason for the change. As changes occur, there will be included or marked on this record set on a daily basis if necessary, to keep them up to date at all times. Actual locations to scale shall be identified on the drawings for all runs of mechanical and electrical work, including all site utilities, installed underground, in walls, floors, and furred spaces, or otherwise concealed. Deviations from the drawings shall be shown in detail. All main runs, whether piping, conduit, duct work, drain lines, etc., shall be located in addition by dimension and elevation. Progress payments may be delayed or withheld until such time as the record set is brought up to date to the satisfaction of the Project Manager. The ESCO shall verify that all changes in the work are included in the "AS-BUILT" drawings and deliver the complete set thereof to the Project Manager for review and approval within thirty (30) calendar days after District's notice of completion. District's acceptance and approval of the "AS-BUILT" drawings are a necessary condition precedent to the release of the final retention.

43. SUBSTITUTION OF SECURITIES

a. Pursuant to Public Contract Code section 22300, ESCO may request in writing that it be allowed at its own expense to substitute securities for moneys withheld by District to ensure performance under this Contract. Only securities listed in Government Code Section 16430 and bank or savings and loan certificates of deposit, interest-bearing demand deposit accounts standby letters of credit, or any other security mutually agreed to by ESCO and District shall qualify under this Article. Securities equivalent to the amount withheld shall be deposited with the District or with a state or federally chartered bank in California as the escrow agent. Upon satisfactory completion of the Contract and on written authorization by the District, the securities shall be returned to ESCO. ESCO shall be the beneficial owner of the securities and shall receive any interest thereon. The ESCO may alternatively request District to make payment of retentions earned directly to the escrow agent at the expense of the ESCO.

b. At the expense of the ESCO, the ESCO may direct the investment of the payments into securities and the ESCO shall receive the interest earned on the investments upon the same terms provided for above for securities deposited by ESCO. Upon satisfactory completion of the contract, ESCO shall receive from the escrow agent all securities, interest, and payments received by the escrow agent from the District. The ESCO shall pay to each Subcontractor, not later than 20 days of receipt of payment, the respective amount of interest earned, net of costs attributed to retention withheld from each Subcontractor, on the amount of retention.

c. Any escrow agreement entered into pursuant to this Article shall comply with Public Contract Code section 22300 and shall be subject to approval by District's counsel.

RFQ/RFP For Solar Photovoltaic System

44. NO DISCRIMINATION

It is the policy of the District that, in connection with all work performed under this public works contract, there shall be no discrimination against any prospective or active employee or any other person engaged in the work because of actual or perceived race, color, ancestry, national origin, ethnic group identification, religion, sex, gender, sexual orientation, age, physical or mental disability, or marital status. The ESCO agrees to comply with applicable Federal and California laws including, but not limited to, the California Fair Employment Practice Act, beginning with Government Code §12900, Government Code §11135, and Labor Code §§ 1735, 1777.5, 1777.6 and 3077.5. In addition, the ESCO agrees to require like compliance by all Subcontractors and suppliers.

45. LABOR STANDARDS

a. Work Hours:

In accordance with Labor Code section 1810, eight (8) hours of labor shall constitute a legal day's work under this Contract. ESCO and any Subcontractor shall pay workers overtime pay as required by Labor Code section 1815. The ESCO shall pay each worker, laborer, mechanic or persons performing work under this Contract at a rate not less than the prevailing wage for each craft or classification covering the work actually performed.

b. Penalty:

ESCO shall forfeit to District as a penalty the sum of twenty-five dollars (\$25.00) for each worker employed in the execution of this Contract by ESCO or any Subcontractor for each calendar day during which the worker is required or permitted to work more than eight (8) hours in any one (1) calendar day or more than forty (40) hours per calendar week in violation of Article 3, Division 2, Part 7, Chapter 1 of the California Labor Code.

c. Employment of Apprentices:

ESCO shall comply with Labor Code §§1773.3, 1777.5 and 1777.6, and 3077 et. seq., each of which is incorporated by reference into this Contract. These sections require that ESCOs and Subcontractors employ apprentices in apprenticeable occupations in a ratio of not less than one (1) hour of apprentice work for every five (5) hours of labor performed by a journeyman, unless an exception is granted and that ESCOs and Subcontractors shall not discriminate against otherwise qualified employees as apprentices on any public works solely on the ground of actual or perceived race, religion, color, national origin, ethnic group identification, sex, gender, sexual orientation, age, or physical or mental disability. Only apprentices who are in training under written apprenticeship occupations shall be employed. The responsibility for compliance with these provisions for all apprenticeable occupations rests with ESCO.

d. The ESCO shall be knowledgeable of and comply with Labor Code sections 1727, 1773.5, 1775, 1777, 1777.5, 1810, 1813, 1860, including all amendments thereto; each of these sections is incorporated by reference into this Contract.

46. GENERAL RATE OF PER DIEM WAGES

a. On File:

As required by Labor Code section 1773.2, the District has available copies of the general prevailing rate of per diem wages for workers employed on public work as determined by the Director of the Department of Industrial Relations, which shall be available to any interested party on request. ESCO shall post a copy of the document at each job site.

RFQ/RFP For Solar Photovoltaic System

b. Prevailing Wage Rate:

The ESCO and each Subcontractor shall pay each worker performing work under this Contract at a rate not less than the prevailing wage as defined in Labor Code section 1771 and 1774 and Section 16000(a) of Title 8, California Code of Regulations.

c. Penalty:

In accordance with Section 1775 of the Labor Code, the ESCO shall forfeit to the District as penalty, the sum of fifty dollars (\$50.00) for each calendar day, or portion thereof, for each worker paid less than the prevailing wage rates, as determined by the Director of the California Department of Industrial Relations, for any work done under this Contract by ESCO or by any Subcontractor. ESCO shall also pay each worker the difference between the stipulated prevailing wages rates and the amount actually paid to such worker.

47. RECORD KEEPING

a. The ESCO agrees to comply with the provisions of Sections 1776 and 1812 of the Labor Code. The ESCO and each Subcontractor shall keep or cause to be kept an accurate record showing the names, addresses, social security numbers, work classifications, straight time and overtime hours worked each day and week of all workers employed by ESCO in connection with the execution of this Contract or any subcontract there under and showing the actual per diem wages paid to each of such workers. These records shall be certified and shall be open at all reasonable hours to the inspection of the District awarding the Contract, its officers and agents, and to the Chief of the Division of Labor Statistics and Law Enforcement of the State Department of Industrial Law Enforcement of the State Department of Industrial Relations, and his or her other deputies and agents.

b. In addition, copies of the above records shall be available as follows:

- 1). A certified copy of an employee's payroll record shall be made available for inspection or furnished to the employee or his or her authorized representative on request;
- 2). A certified copy of all payroll records shall be made available for inspection or furnished upon request to the District, the Division of Labor Standards Enforcement, and the Division of Apprenticeship Standards of the Department of Industrial Relations;
- 3). A certified copy of all payroll records shall be made available upon request by the public for inspection or copies thereof made; provided, however, that a request by the public shall be made through either the District, the Division of Apprenticeship Standards, or the Division of Apprenticeship Standards, or the Division of Labor Standards Enforcement. If the requested payroll records have not been previously provided, the requesting party shall, prior to being provided the records, reimburse the costs of the ESCO, Subcontractors, and the entity through which the request was made. The public shall not be given access to the records at the principal office of the ESCO.

c. The ESCO shall file a certified copy of the records with the entity requesting the records within ten days after receipt of a written request. Any copy of records made available for inspection as copies and furnished upon request to the public or any public agency by the District, shall be marked or obliterated in such a manner as to prevent disclosure of an individual's name, address, and social security number. The name and address of the ESCO awarded the Contract or performing the Contract shall not be marked or obliterated.

RFQ/RFP For Solar Photovoltaic System

- d. The ESCO shall inform the Owner of the location of the records, including the street address, city and county, and shall, within five working days, provide a notice of a change of location and address.
- e. In the event of noncompliance with the requirements of this section, the ESCO shall have ten days in which to comply subsequent to receipt of written notice specifying in what respects the ESCO must comply with this section. Should noncompliance still be evident after the ten-day period, the ESCO shall, as a penalty to the District, forfeit one hundred dollars (\$100.00) for each calendar day, or portion thereof, for each worker, until strict compliance is effectuated. Upon the request of the Division of Apprenticeship Standards or the Division of Labor Standards Enforcement, these penalties shall be withheld from progress payments then due.
- f. Responsibility for compliance with this provision shall be with the ESCO.

48. PROJECT COMPLETION

- a. When all of the work to be performed under this Contract is has been fully completed, the ESCO shall notify the Project Manager and District, in writing, setting a date for inspection. The ESCO and Subcontractor representatives shall attend the inspection. As a result of this inspection, the Project Manager will prepare a list of items ("punch list") that are incomplete or not installed according to the Contract Documents. Failure to include items on this list does not relieve the ESCO from fulfilling all requirements of the Contract Documents.
- b. The Project Manager will promptly deliver the punch list to the ESCO and it will include a period of time by which the ESCO shall complete all items listed thereon. On completion of all items on the punch list, verified by a final inspection, and all other Contract requirements, so that Final Completion has been achieved to the District's satisfaction, the District will file a Notice of Completion with the County Recorder. Payment of retention from the Contract, less any sums withheld pursuant to the terms of this Contract or applicable law, shall not be made sooner than thirty-five (35) calendar days after the date of filing of Notice of Completion.
- c. District reserves the right to occupy buildings and/or portions of the site at any time before Completion, and occupancy shall not constitute final acceptance of any part of the Work covered by the Contract Documents, nor shall such occupancy extend the date specified for completion of the Work. Beneficial occupancy of building(s) does not commence any warranty period or entitle ESCO to any additional compensation due to such occupancy or affect in any way or amount ESCO's obligation to pay liquidated damages for failure to complete the Project on time.

49. TRENCHING OR OTHER EXCAVATIONS

- a. Excavations or Trenches Deeper than Four Feet:

If the project involves digging trenches or other excavations that extend deeper than four feet, the following provisions shall be a part of this Contract:

- 1). The ESCO shall promptly, and before the following conditions are disturbed, provide written notice to the District if the ESCO finds any of the following conditions:
 - (a) Material that the ESCO believes may be a hazardous waste, as defined in Section 25117 of the Health and Safety Code, which is required to be removed to a Class I, Class II, or Class III disposal site in accordance with the provisions of existing law.
 - (b) Subsurface or latent physical conditions at the site which are different from those indicated or expected.

RFQ/RFP For Solar Photovoltaic System

(c) Unknown physical conditions at the site of any unusual nature or which are materially different from those ordinarily encountered and generally recognized as inherent in work which the ESCO generally performs.

2). In the event that the ESCO notifies the District that ESCO has found any of the conditions specified in subparagraphs (a), (b) or (c), above, the District shall promptly investigate the condition(s). If the District finds that the conditions are materially different or that a hazardous waste is present at the site which will affect the ESCO's cost of, or the time required for, performance of the Contract, the District shall issue a change order in accordance with the procedures set forth in this Contract.

3). In the event that a dispute arises between the District and the ESCO regarding any of the matters specified in Paragraph (2), above, the ESCO shall proceed with all work to be performed under the Contract and the ESCO shall not be excused from completing the Project as provided in the Contract. In performing the work pursuant to this Paragraph, the ESCO retains all rights provided by Article 50 which pertains to the resolution of disputes between the contracting parties.

b. Regional Notification Center:

The ESCO, except in an emergency, shall contact the appropriate regional notification center at least two (2) days prior to commencing any excavation if the excavation will be conducted in an area that is known, or reasonably should be known, to contain subsurface installations other than the underground facilities owned or operated by the District, and obtain an inquiry identification number from that notification center. No excavation shall be commenced and/or carried out by the ESCO unless an inquiry identification number has been assigned to the ESCO or any Subcontractor and the ESCO has given the District the identification number. Any damages or delays arising from ESCO's failure to make appropriate notification shall be at the sole risk and expense of the ESCO and shall not be considered for an extension of the Contract time.

c. Existing Utility Lines:

1). Pursuant to Government Code section 4215, the District assumes the responsibility for removal, relocation, and protection of main or trunk utility lines and facilities located on the construction site at the time of commencement of construction under this contract with respect to any such utility facilities that are not identified in the plans and Specifications. ESCO shall not be assessed for liquidated damages for delay in completion of the Project caused by the failure of the District or the owner of a utility to provide for removal or relocation of such utility facilities.

2). Locations of existing utilities provided by the District shall not be considered exact, but approximate within reasonable margin and shall not relieve ESCO of responsibilities to exercise reasonable care nor costs of repair due to ESCO's failure to do so. The District shall compensate ESCO for the costs of locating and repairing damage not due to the failure of ESCO to exercise reasonable care and removing or relocating such utility facilities not indicated in the plans and Specifications with reasonable accuracy.

3). No provision herein shall be construed to preclude assessment against ESCO for any other delays in completion of the project. Nothing in this Section shall be deemed to require the District to indicate the presence of existing service laterals, appurtenances, or other utility lines, with the exception of main or trunk lines, whenever the presence of such utilities on the site of the construction Project can be inferred from the presence of other visible facilities, such as buildings, meter and junction boxes, on or adjacent to the site of the construction.

4). If ESCO, while performing work under this Contract, discovers utility facilities not identified by the District in the project plans and Specifications, ESCO shall immediately notify the District

RFQ/RFP For Solar Photovoltaic System

and the utility in writing. The cost of repair for damage to above-mentioned visible facilities without prior written notification to the District shall be borne by the ESCO.

d. Prompt Notification:

ESCO understands, acknowledges and agrees that the purpose for prompt notification to the District pursuant to these provisions is to allow the District to investigate the condition(s) so that the District shall have the opportunity to decide how the District desires to proceed as a result of the conditions. Accordingly, failure of ESCO to promptly notify the District in writing, pursuant to these provisions, shall constitute ESCO's waiver of any claim for damages incurred as a result of the conditions.

e. Trenches Five Feet and Deeper:

Pursuant to Labor Code section 6705, if the contract price exceeds \$25,000 and involves the excavation of any trench or trenches five (5) feet or more in depth, the ESCO shall, in advance of excavation, promptly submit to the District and/or a registered civil or structural engineer employed by the District or Project Manager, a detailed plan showing the design of shoring for protection from the hazard of caving ground during the excavation of such trench or trenches.

50. RESOLUTION OF CONSTRUCTION CLAIMS

a. Public work claims of \$375,000 or less between the ESCO and the District are subject to the provisions of Article 1.5 (commencing with §20104) of Chapter 1 of Part 2 of the Public Contract Code ("Article 1.5 claim"). For purposes of Article 1.5, "public work" has the same meaning as set forth in §§3100 and 3106 of the Civil Code; "claims" means a separate demand by ESCO for a time extension or payment of money or damages arising from work done by or on behalf of ESCO pursuant to the Contract and payment of which is not otherwise expressly provided for or the claimant is not otherwise entitled to or the amount of the payment which is disputed by the District.

b. All claims shall be submitted on or before the date of the Final Payment and shall include all documents necessary to substantiate the claim. District shall respond in writing within 45 days of receipt of claim if the claim is less than or equal to \$50,000 ("50,000 claim") or within 60 days if the claim is over \$50,000 but less than or equal to \$375,000 ("50,000 - \$375,000 claim"). In either case, District may request in writing within 30 days of receipt of claim any additional documentation supporting the claim or relating to any defenses to the claim which the District may have against the ESCO. Any additional information shall be requested and provided upon mutual agreement of the District and the ESCO. District's written response to the claim shall be submitted to ESCO within 15 days after receipt of the further documentation for \$50,000 claims or within 30 days after receipt of the further documentation for \$50,000 - \$375,000 claims or within a period of time no greater than that taken by the ESCO in producing the additional information, whichever is greater.

c. Within 15 days of receipt of the District's response, if ESCO disputes the District's written response, or within 15 days of the District's failure to respond within the time prescribed, the ESCO shall provide written notification to District demanding an informal conference to meet and confer ("conference") to be scheduled by District within 30 days. Following the conference, if any claim or portion remains in dispute, the ESCO may file a claim as provided in Chapter 1 (commencing with §900) and Chapter 2 (commencing with §910) of Part 3 of Division 3.6 of Title 1 of the Government Code. For purposes of those provisions, the period of time within which a claim must be filed is tolled from the time the claimant submits a written claim pursuant to this section until the time that claim is denied as a result of the conference process, including any period of time utilized by the meet and confer process.

RFQ/RFP For Solar Photovoltaic System

d. Pursuant to Public Contract Code §20104.2(f), this section does not apply to tort claims and does not change the period for filing claims or actions specified by Chapter 1 (commencing with §900) and Chapter 2 (commencing with §910) of Part 3 of Division 3.6 of Title 1 of the Government Code.

e. If a civil action is filed, within 60 days, but no earlier than 30 days, following the filing of responsive pleadings, the court shall submit the matter to nonbinding mediation unless waived by mutual stipulation of both parties. The mediation process shall provide that both parties select a disinterested third person mediator within 15 days, shall be commenced within 30 days of the submittal, and shall be concluded within 15 days of the commencement of the mediation unless time is extended upon a good cause showing to the court or by stipulation of the parties. If the parties fail to select a mediator within the 15-day period, any party may petition the court to appoint the mediator.

f. If the matter remains in dispute, the case shall be submitted to judicial arbitration as set forth in Public Contract Code §§20104.4 (b)(1) through (b)(3).

g. For any claim in excess of \$375,000, the ESCO and the District shall follow the same process as for an Article 1.5 claim. The District will forward a response within 60 days of submittal of any such claim. Judicial arbitration is not required for claims in excess of \$375,000. Claims shall also be processed consistent with Public Contract Code section 9204, which provides processing timelines and procedures, and requires that undisputed claims be promptly paid in accordance with this code provision.

h. In addition, for all unresolved claims that the ESCO wishes to pursue, the ESCO shall file a timely claim pursuant to the Government Claims Act and shall otherwise comply with the procedures set forth in that Act prior to commencing any litigation against the District. The accrual date for any such claim is the date the dispute or controversy first arose regarding the issues raised in the claim.

i. “The date of Final Payment,” as used in this Article 50, means the date the public entity is required to release retention proceeds in accordance with Public Contract Code §7107 regardless of whether any payment is made to the ESCO at that time.

j. The claims required by this Article are jurisdictional and conditions precedent to the commencement of any further legal proceedings. Strict compliance with all filing deadlines is mandatory.

51. DISABLED VETERANS PARTICIPATION GOALS (Applies to K-12 districts only.)

In accordance with Education Code §17076.11, this District has a participation goal for disabled veteran business enterprises (“DVBE”) of at least 3 percent (3%) per year of the overall dollar amount of funds allocated to the District by the State Allocation Board pursuant to the Leroy F. Greene School Facilities Act of 1998 for construction or modernization and expended each year by the District. Prior to, and as a condition precedent for final payment under any contract for such project, the ESCO shall provide appropriate documentation to the District identifying the amount paid to DVBE in conjunction with the Contract, so that the District can assess its success at meeting this goal.

52. RETENTION OF DVBE RECORDS (Applies to K-12 districts only.)

The ESCO agrees that, for all contracts subject to DVBE participation goals, the State and the District have the right to review, obtain and copy all records pertaining to performance of the contract in accordance with DVBE requirements. The ESCO agrees to provide the State or the District with any relevant information requested and shall permit the State or District access to its premises upon

RFQ/RFP For Solar Photovoltaic System

reasonable notice for purposes of interviewing employees and inspecting records. The ESCO agrees to maintain such records for a period of three years after final payment under the Contract.

53. FINGERPRINTING (Applies to K-12 districts only.)

District Determination of Fingerprinting Requirement Application

The District has considered the totality of the circumstances concerning the Project and has determined that the ESCO and ESCO's employee (which includes **Subcontractor employees**):

_____ are subject to the requirements of Education Code §45125.2 and Paragraph (a) below, is applicable.

X are not subject to the requirements of Education Code §45125.2, and Paragraph (b) below, is applicable.

a. Contracts for Construction, Reconstruction, Rehabilitation or Repair of a School Facility Involving More than Limited Contact with Students (§45125.2)

By execution of the Contract, the ESCO acknowledges that ESCO is entering into a contract for the construction, reconstruction, rehabilitation, or repair of a school facility where the ESCO and/or ESCO's employees will have more than limited contact with students and the services to be provided do not constitute an emergency or exceptional situation. In accordance with Education Code §45125.2 the ESCO shall, at ESCO's own expense, (1) install a physical barrier to limit contact with students by ESCO and/or ESCO's employees, and/or (2) provide for the continuous supervision and monitoring of the ESCO and/or ESCO's employees by an employee of the ESCO who has received fingerprint clearance from the California Department of Justice, and/or (3) provide for the surveillance of the ESCO and ESCO's employees by a District employee.

b. Contracts for Construction, Reconstruction, Rehabilitation or Repair of a School Facility Involving Only Limited Contact with Students (§45125.2)

By execution of the Contract, the ESCO acknowledges that ESCO is entering into a contract for the construction, reconstruction, rehabilitation or repair of a school facility involving only limited contact with students. Accordingly, the parties agree that the following conditions apply to any work performed by the ESCO and ESCO's employees on a school site: (1) ESCO and ESCO's employees shall check in with the school office each day immediately upon arriving at the school site; (2) ESCO and ESCO's employees shall inform school office staff of their proposed activities and location at the school site; (3) Once at such location, ESCO and ESCO's employees shall not change locations without contacting the school office; (4) ESCO and ESCO's employees shall not use student restroom facilities; and (5) If ESCO and/or ESCO's employees find themselves alone with a student, ESCO and ESCO's employees shall immediately contact the school office and request that a member of the school staff be assigned to the work location.

54. LABOR COMPLIANCE PROGRAM

If this Contract is for a public works project over \$25,000 or for a maintenance project over \$15,000, ESCO acknowledges that the project is subject to compliance monitoring and enforcement by the California Department of Industrial Relations in accordance with California Labor Code sections 1725.5 and 1770 *et seq.* All contractors and subcontractors working at the site shall be duly registered with the Department of Industrial Relations at time of bid opening and at all relevant times. Proof of registration shall be provided as to all such contractors prior to the commencement of any work.

RFQ/RFP For Solar Photovoltaic System

ESCO shall coordinate with the Architect to ensure that DIR is advised of the award of the construction contract in a timely manner by filing form PWC-100 with DIR within thirty days of award of the contract, but no later than the first day in which the ESCO has workers employed upon the project.

55. DRUG-FREE WORKPLACE CERTIFICATION

ESCO certifies all of the following:

- a. ESCO is aware of the provisions and requirements of California Government Code §§ 8350 et seq., the Drug Free Workplace Act of 1990.
- b. ESCO is authorized to certify, and does certify, that a drug free workplace will be provided by doing all of the following:
 - 1). Publishing a statement notifying all employees that the unlawful manufacture, distribution, dispensation, possession or use of a controlled substance is prohibited in ESCO's workplace and specifying actions which will be taken against employees for a violation of the prohibition;
 - 2). Establishing a drug-free awareness program to inform employees about all of the following:
 - (i) The dangers of drug abuse in the workplace;
 - (ii) ESCO's policy of maintaining a drug-free workplace;
 - (iii) The availability of drug counseling, rehabilitation and employee-assistance programs; and
 - (iv) The penalties that may be imposed upon employees for drug abuse violations;
 - 3.) Requiring that each employee engaged in the performance of Work on the Project be given a copy of the statement required by subdivision (a), above, and that as a condition of employment by ESCO in connection with the Work on the Project, the employee agrees to abide by the terms of the statement.
- c. ESCO understands that if the District determines that ESCO has either: (a) made a false certification herein, or (b) violated this certification by failing to carry out and to implement the requirements of Government Code §§ 8350 et seq., the Contract is subject to termination, suspension of payments, or both. ESCO further understands that, should ESCO violate the terms of the Drug-Free Workplace Act of 1990, ESCO may be subject to debarment in accordance with the provisions of Government Code §§ 8350, et seq.

56. PROVISIONS REQUIRED BY LAW DEEMED INSERTED

Every provision of law and clause required by law to be inserted in this Contract shall be deemed to be inserted, and this Contract shall be read and enforced as though it were included, and if through mistake or otherwise any provision is not inserted or is not correctly inserted, upon application of either party the Contract shall be amended to make the insertion or correction. All references to statutes and regulations shall include all amendments, replacements, and enactments on the subject which are in effect as of the date of this Contract.

57. GENERAL PROVISIONS

- a. Assignment and Successors:

Neither party may transfer or assign its rights or obligations under the Contract Documents, in part or in whole, without the other party's prior written consent. The Contract Documents are binding on the heirs, successors, and permitted assigns of the parties hereto.

RFQ/RFP For Solar Photovoltaic System

b. Third Party Beneficiaries:

There are no intended third-party beneficiaries to the Contract.

c. Choice of Law and Venue

The Contract Documents shall be governed by California law, and venue shall be in the Superior Court of the county in which the project is located, and no other place.

d. Severability

If any provision of the Contract Documents is determined to be illegal, invalid, or unenforceable, in part or in whole, the remaining provisions, or portions of the Contract Documents shall remain in full force and effect.

e. Entire Agreement

The Contract Documents constitute the final, complete, and exclusive statement of the terms of the agreement between the parties regarding the subject matter of the Contract Documents and supersedes all prior written or oral understandings or agreements of the parties.

f. Waiver

No waiver of a breach, failure of any condition, or any right or remedy contained in or granted by the provisions of the Contract Documents shall be effective unless it is in writing and signed by the party waiving the breach, failure, right, or remedy. No waiver of any breach, failure, right, or remedy shall be deemed a waiver of any other breach, failure, right, or remedy, whether or not similar, nor shall any waiver constitute a continuing waiver unless the writing so specifies.

g. Headings

The headings in the Contract Documents are included for convenience only and shall neither affect the construction or interpretation of any provision in the Contract Documents nor affect any of the rights or obligations of the parties to the Contract.

--End--

APPENDIX D: PERFORMANCE BOND

WHEREAS, the Governing Board of the Mattole Unified School District (“District”), at its meeting on _____, 2020, has awarded to _____ (“Principal”), the Contract for performance of the following project (“Project”):

Solar Photovoltaic Systems

WHEREAS, the Principal is required under the terms of the Contract to furnish a bond to the District as obligee ensuring its full and faithful performance of the Contract Documents, which are fully incorporated herein by this reference,

NOW, THEREFORE, we, the Principal and _____, as Surety, hereby guarantee the Principal’s full, faithful and complete performance of the Contract Document requirements in the penal sum of _____ dollars (\$ _____) for the payment of which sum will and truly be made, we bind ourselves, our heirs, executors, administrators and successors, jointly, severally, and firmly by this agreement to perform or have performed all of the work and activities required to complete the Project pursuant to the Contract Documents and to pay to the District all damages the District incurs as a result of the Principal’s failure to fully perform in accordance with the Contract Documents.

The condition of the obligation is such that if the Principal, its heirs, executors, administrators, successors or assigns shall in all things abide by, and well and truly keep and perform the covenants, conditions and agreements in the Contract Documents and any amendment thereof made as therein provided, on its or their parts to be kept and performed at the time and in the manner therein specified, and in all respects according to their true intent and meaning, and shall insure and indemnify and save harmless the District, its officers and agents, as therein stipulated, then this obligation shall become null and void. Otherwise, it shall be and remain in full force and effect.

The Surety, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the Contract Documents shall in any way affect its obligations on this bond and it does hereby waive notice of any such change, extension of time, alteration or addition.

Principal and Surety further agree to pay all costs incurred by the District in connection with enforcement of this bond, including, but not limited to the District’s reasonable attorney’s fees and costs incurred, with or without suit, in addition to any other sum required by this bond. Surety further agrees that death, dissolution, or bankruptcy of the Principal shall not relieve the Surety of its obligations hereunder.

RFQ/RFP For Solar Photovoltaic System

In witness whereof, this instrument has been duly executed by the Principal and Surety this _____ day of _____, 2020.

*To be signed by
Principal and Surety
and acknowledgment
and notarial seal to
be attached.*

PRINCIPAL

By: _____

TITLE _____

SURETY

By: _____

TITLE _____

The above bond is accepted and approved this _____ day of _____, 2020.

By: _____
Authorized District Signature

APPENDIX E: PAYMENT BOND

WHEREAS, the Mattole Unified School District (“District”) and the ESCO, _____ (“Principal”) have entered into a contract (“Contract”) for the furnishing of all materials, labor, services, equipment, tools, supervision and transportation necessary, convenient and proper for the Solar Photovoltaic Systems project (“Project”) which Contract dated _____, 2020, and all of the Contract Documents made part thereof are fully incorporated herein by this reference; and

WHEREAS, ESCO/Principal is required by Division 4, Part 6, Title 3, Chapter 5 (commencing at Section 9550) of the California Civil Code to furnish a bond in connection with the contract;

NOW, THEREFORE, we, the ESCO/Principal and _____ as Surety, are held firmly bound unto Owner in the penal sum of \$ _____ Dollars (\$ _____), lawful money of the United States of America for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators, successors, and assigns, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH that if the ESCO/Principal, his/her or its heirs, executors, administrators, successors, or assigns, or a Subcontractor, shall fail to pay any person or persons named in Civil Code Section 9100 or fail to pay for any materials or other supplies used in, upon, for, or about the performance of the work contracted to be done, or for any work or labor thereon of any kind, or for amounts due under the Unemployment Insurance Code with respect to work or labor thereon of any kind, or shall fail to deduct, withhold, and pay over to the Employment Development Department any amounts required to be deducted, withheld, and paid over by Section 13020 of the Unemployment Insurance Code with respect to work and labor thereon of any kind, then said Surety will pay for the same, in or to an amount not exceeding the amount set forth above, and in case suit is brought upon this bond Surety will also pay such reasonable attorney's fees as shall be fixed by the court, awarded and taxed as provided in Division 4, Part 6, Title 3, Chapter 5 (commencing at Section 9550) of the California Civil Code.

This bond shall inure to the benefit of any of the persons named in Section 9100 of the California Civil Code so as to give a right of action to such person or their assigns in any suit brought upon this bond. It is further stipulated and agreed that the Surety of this bond shall not be exonerated or released from the obligation of the bond by any change, extension of time for performance, addition, alteration, or modification in, to, or of any contract, plans, specifications, or agreement pertaining or relating to any scheme or work of improvement described above or pertaining or relating to the furnishing of labor, materials, or equipment therefore, nor by any change or modification of any terms of payment or extension of the time for any payment pertaining or relating to any scheme or work of improvement described above, nor by any rescission or attempted rescission of the contract, agreement, or bond, nor by any conditions precedent or subsequent in the bond attempting to limit the right of recovery of claimants otherwise entitled to recover under any such contract or agreement or under the bond, nor by any fraud practiced by any person other than the claimant seeking to recover on the bond, and that this bond be construed most strongly against the Surety and in favor of all persons for whose benefit such bond is given, and under no circumstances shall Surety be released from liability to those for whose

RFQ/RFP For Solar Photovoltaic System

benefit such bond has been given, by reason of any breach of contract between the Owner and original ESCO or on the part of any obligee named in such bond, but the sole conditions of recovery shall be that claimant is a person described in Section 8400 and 8402 of the California Civil Code and has not been paid the full amount of his/her or its claim and that Surety does hereby waive notice of any such change, extension of time, addition, alteration, or modification.

In witness whereof, this instrument has been duly executed by the Principal and Surety this _____ day of _____, 2020.

*To be signed by
Principal and Surety
and acknowledgment
and notarial seal to
be attached.*

PRINCIPAL

By:

Title

SURETY

By:

Title

The above bond is accepted and approved this _____ day of _____, 2020.

By: _____
Authorized District Signature

APPENDIX F: WARRANTY BOND

KNOW ALL PERSONS BY THESE PRESENTS, that

WHEREAS, the Mattole Unified School District (“District”) and the contractor _____, (“Principal”) have entered into a Contract (“Contract”) for the following project (Project):

Solar Photovoltaic Systems

WHEREAS, Principal is required under the terms of the Agreement to furnish warranty security for the work performed pursuant to the Agreement in the amount of \$ _____ to guarantee replacement and repair of the improvements as described in the Agreement for a period of one year following the date of recordation of the notice of acceptance of the Improvements against any defective work or labor done, or defective materials furnished.

NOW, THEREFORE, we, the Principal, and _____ as Surety, are held and firmly bound unto the District in the penal sum of _____ Dollars (\$ _____) lawful money of the United States, being not less than 10 percent (10%) of the amount payable by the terms of the Contract, for the payment of which sum well and truly to be made we bind ourselves, our heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

The condition of this obligation is such that if Principal shall indemnify District for all loss that District may sustain by reason of any defective materials or workmanship which become apparent during the period of one year from and after acceptance of the improvements by the District Council of District, then this obligation shall be null and void; otherwise, this obligation shall remain in full force and effect.

As a part of the obligation secured hereby and in addition to the face amount specified, costs and reasonable expenses and fees shall be included, including reasonable attorneys’ fees incurred by District in successfully enforcing the obligation, all to be taxed as costs and included in any judgment rendered.

Surety’s obligations hereunder are independent of the obligations of any other surety for the performance of the Contract, and suit may be brought against Surety and such other sureties, jointly and severally, or against any one or more of them, or against less than all of them without impairing the District’s rights against the others.

No right of action shall accrue on this bond to or for the use of any person or corporation other than the District or its successors or assigns.

Surety shall provide District with thirty (30) days’ written notice of Principal’s default prior to Surety terminating, suspending or revoking the bond.

The Surety hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract or to the work to be performed there under or the Specifications accompanying the same shall in any way affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract or to the work or to

RFQ/RFP For Solar Photovoltaic System

the Specifications.

IN WITNESS WHEREOF, the above-bound parties have executed this instrument under their seals this _____ day of _____, 2020, the name and corporate seal of each corporate body being hereto affixed, and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

*To be signed by
Principal and Surety
and acknowledgment
and notarial seal to
be attached.*

PRINCIPAL

By: _____

TITLE _____

SURETY

By: _____

TITLE _____

The above bond is accepted and approved this _____ day of _____, 2020.

By: _____
Authorized District Signature

Print Name & Title

APPENDIX H: TECHNICAL FACILITY PROFILE

Operating Information

- Mattole Unified School District Summer Break begins June 15, 2020 – the District requests that the PV system installations occur during Summer Break.

Site and Building Information

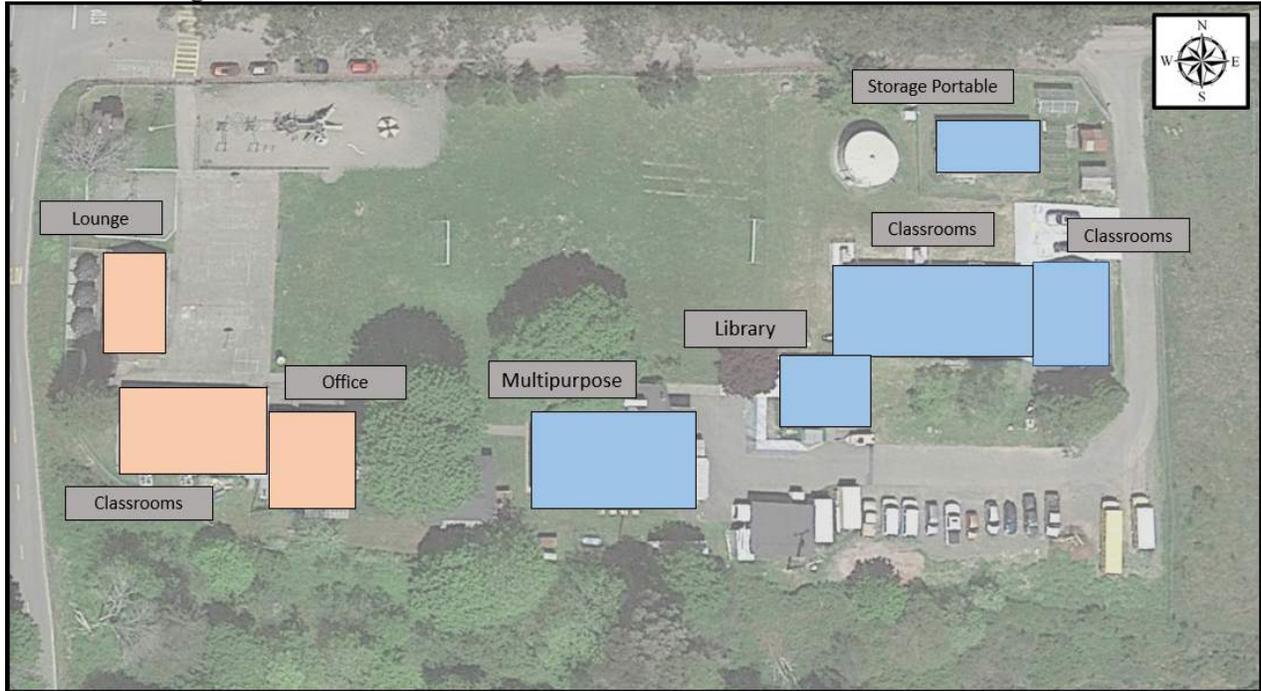


Figure 1 Satellite image of Mattole Elementary (orange) and Triple Junction High School (blue) buildings.



Figure 2 Available roof area for solar PV installation at Mattole's Triple Junction High School

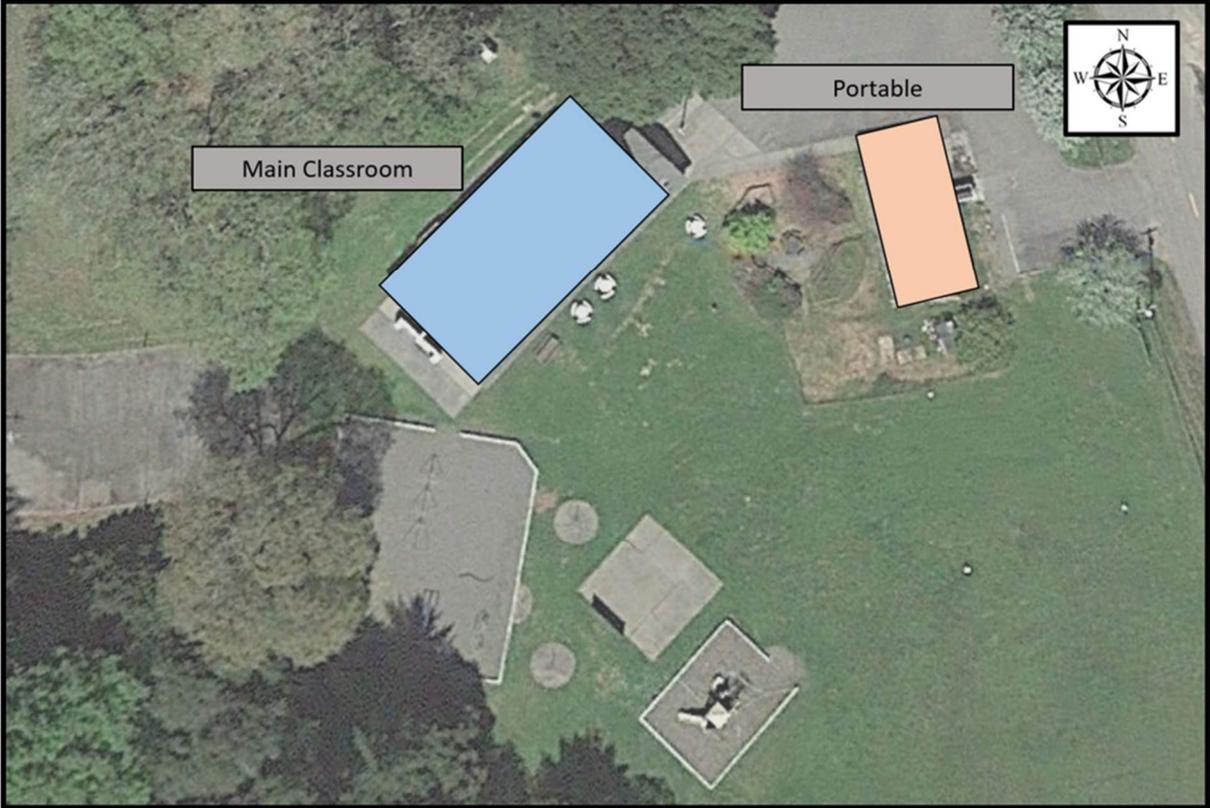


Figure 3 Satellite image of Honeydew Elementary buildings.



Figure 4 Available roof area for solar installation at Honeydew Elementary School.



REDWOOD COAST Energy Authority

Humboldt County • Arcata • Blue Lake • Eureka • Ferndale • Fortuna • Rio Dell • Trinidad • Humboldt Bay Municipal Water District

Energy Audit Report

Mattole Unified School District

29289 Chambers Rd, Petrolia CA, 95558

Auditor: Redwood Coast Energy Authority

May 2019



Mattole Elementary School -- 29289 Chambers Rd, Petrolia CA, 95558
Honeydew Elementary School -- Wilder Ridge Rd, Honeydew, CA, 95545

Striving to develop and implement sustainable energy initiatives that reduce energy demand, increase energy efficiency, and advance the use of clean, efficient and renewable resources available in the region.



REDWOOD COAST Energy Authority

County of Humboldt • Arcata • Blue Lake • Eureka • Ferndale • Fortuna • Rio Dell • Trinidad • Humboldt Bay Municipal Water District

To: The California Energy Commission

From: Mike Avcollie, Project Manager, Redwood Coast Energy Authority

Date: May 31, 2019

Subject: Mattole Unified School District's Application for the Energy Conservation Assistance Act Educational Sub-account (ECAA-Ed) PON-18-101

Dear California Energy Commission,

The Mattole Unified School District (MUSD) is working with Redwood Coast Energy Authority (RCEA) to prepare the required loan application, loan application attachments and supporting documents to apply for the CEC's Energy Conservation Assistance Act Educational Sub-account (ECAA-Ed) PON-18-101.

RCEA's analysis estimates that a 4.8 kW DC solar array could offset 110% of the Honeydew electric use and that an 8 kW DC solar array could offset 14% of the electric use at the Mattole School's four (4) metered locations. Together, the combined solar PV installation would be 12.8 kW DC, capable of producing roughly 17,600 kWh annually which would offset 21% of the entire District's electric consumption and 14% of the District's overall energy use. You will find the following documentation in support of the loan application:

| | |
|--|-------------------|
| Application Cover Letter: | PDF |
| ECAA-Ed Loan Application: | Attachment 1 |
| Summary of Energy Projects in Loan Request: | Attachment 2 |
| Sample Governing Board Resolution: | Attachment 3 |
| CEQA Notice of Exemption: | Attachment 4 |
| Jobs Creation Estimate: | Attachment 5 |
| Energy Audit Report: | Attachment 6 |
| Contacts: | Attachment 7 |
| ECAA-Ed Audit Tables: | Excel Spreadsheet |
| Honeydew Project Analysis Data and Calculations: | Excel Spreadsheet |
| Mattole Project Analysis Data and Calculations: | Excel Spreadsheet |
| Combined Project Analysis Data and Calculations: | Excel Spreadsheet |

Please feel free to contact me if you have any questions regarding the application, the audit tables, the audit report or its findings.

Thank you,
Mike Avcollie

Project Manager

Redwood Coast Energy Authority

mavcollie@redwoodenergy.org

Table of Contents

- 1 Executive Summary5
- 2 Introduction.....6
 - 2.1 LEA and Site Descriptions6
 - 2.2 Operating Schedules.....6
 - 2.3 Local Weather Statistics6
 - 2.4 Audit Objectives6
- 3 Facility Background and Site Description7
 - 3.1 Mattole School7
 - 3.1.1 Mattole Facility Description8
 - 3.2 Honeydew Elementary School.....9
 - 3.2.1 Honeydew Facility Description9
- 4 Energy Using Systems 10
 - 4.1 Lighting Systems 10
 - 4.2 Heating, Ventilation, and Air Conditioning (HVAC) 10
 - 4.3 Domestic Hot Water 11
 - 4.4 Office Equipment and Plug Loads..... 11
- 5 Existing Energy Use..... 11
 - 5.1 Site Annual Electric Usage. 11
 - 5.2 Site Annual Propane Use 12
 - 5.3 Energy Use Patterns 14
 - 5.4 Energy Balance 14
 - 5.5 Rate Simulation and Analysis of Rate Schedules..... 14
- 6 Audit Activity and Results..... 15
 - 6.1 Solar Photovoltaic (PV) Site Analysis 15
 - 6.2 Solar Photovoltaic (PV) System Size 18
 - 6.3 System Cost 20
 - 6.4 Audit Results..... 21
 - 6.5 Audit Methodology..... 23
- Appendix A Honeydew Elementary Site Map 27
- Appendix B Mattole School Site Map 27
- Appendix C Design Module Specifications..... 28

List of Tables

- Table 1 Baseline energy use and costs for MUSD.5
- Table 2 Summary of recommended energy projects for MUSD.5
- Table 3 CEC ECAA-Ed scoring rubric for MUSD energy projects.6
- Table 4 Monthly electric consumption at all individual meters for MUSD from May 2018 to April 2019. 11
- Table 5 Summary of annual electric use and costs at Mattole Unified School District. 12
- Table 6 Monthly electric load for Mattole Unified School District’s five meters..... 13
- Table 7 Energy use and cost by fuel type at Mattole Unified School District. 14
- Table 8 Time of Use rate for Mattole Unified School District’s five meters..... 15
- Table 9 Monthly electric load versus monthly solar PV output for Mattole School. 19
- Table 10 Monthly electric load versus solar PV output for Honeydew Elementary School..... 20
- Table 11 Summary of Combined 12.8 kW DC solar PV system for MUSD. 20
- Table 12 Estimated costs for a 12.8 kW DC solar PV array for MUSD..... 21
- Table 13 Summary of project metrics for the Mattole solar project and the Honeydew Solar Project. 21
- Table 14 CEC’s ECAA-Ed loan scoring rubric for the Ridgewood Solar Project. 21
- Table 15 Average global horizontal irradiance on a flat plane for MUSD sites..... 23
- Table 16 Average global horizontal irradiance at azimuth 180 degrees and a tilt of 26.5 degrees..... 23
- Table 17 Mattole USD PV System Sizing Inputs..... 23
- Table 18 Example of RCEA's solar PV system sizing. 25
- Table 19 Summary of RCEAs annual energy production analysis. 26

List of Figures

Figure 1 Mattole School and Honeydew Elementary locations in Humboldt County CA, CEC Climate Zone 1.7

Figure 2 Mattole School, in Petrolia, CA.....8

Figure 3 Facility layout of Mattole School.....8

Figure 4 Honeydew Elementary School’s meter location.9

Figure 5 Facility layout of Honeydew Elementary School. 10

Figure 6 Monthly electric use and costs at Mattole Unified School District. 12

Figure 7 Monthly propane use and cost for Mattole Unified School District. 13

Figure 8 MUSD’s energy use balance by fuel type. 14

Figure 9 Available roof area for solar PV installation at Mattole School. 16

Figure 10 Available roof area for solar installation at Honeydew Elementary School..... 17

Figure 11 Potential roof damage on northwest face of the roof at Honeydew Elementary School..... 17

Figure 12 Monthly electric use versus solar PV output for proposed solar project at Mattole School..... 18

Figure 13 Monthly electric use versus solar PV output at Honeydew Elementary School. 19

1 Executive Summary

The Mattole Unified School District (MUSD) is located within Humboldt County, California with the District Office at 29289 Chambers Rd, Petrolia CA, 95558. The District comprises two sites: Mattole Elementary School, also located on Chambers Rd in Petrolia, and Honeydew Elementary School, located at Wilder Ridge Rd, Honeydew, CA, 95545.

The Redwood Coast Energy Authority (RCEA) performed a detailed solar site analysis at the Mattole site and Honeydew sites on September 27, 2018. The California Energy Commission released Program Opportunity Notice (PON) 18-101, the Energy Conservation Assistance Act Educational program (ECAA-ED) in February of 2019. RCEA has researched the loan requirements and is helping put together a loan application package for MUSD to apply for the CEC’s ECAA-Ed loan program. The ECAA-Ed program looks at overall site energy use, including propane, natural gas, and diesel use. Table 1 below shows both Mattole’s and Honeydew’s total energy use and costs by fuel type.

Table 1 Baseline energy use and costs for MUSD.

| Baseline Energy Use and Cost – Mattole Unified School District | | | | | | |
|--|---------------|--------------------|--------------|--------------------|------------------------------------|------------------------|
| Site | Electricity | | Propane | | Total | |
| | kWh/year | \$/year | Gal/ year | \$/year | Annual Energy Use (Million BTU) | Annual Cost \$/year |
| Mattole School | 81,372 | \$18,041.09 | 3,466 | \$9,816.41 | 1,192.6 | \$27,857.50 |
| Honeydew Elementary | 5,401 | \$1,329.58 | 696 | \$2,063.14 | 122.3 | \$3,392.72 |
| Total | 86,773 | \$19,370.67 | 4,162 | \$11,879.55 | 1,314.9 | \$31,250.22 |

MUSD is working with Redwood Coast Energy Authority (RCEA) on these projects. As part of that work, RCEA performed an analysis of the solar photovoltaic installation opportunities at the Mattole School and Honeydew Elementary sites in September of 2018. RCEA estimates that a 4.8 kW DC solar array could offset 110% of the Honeydew electric use and that an 8 kW DC solar array could offset 14% of the electric use at the Mattole School’s four (4) metered locations. Together, the combined solar PV installation would be 12.8 kW DC, capable of producing roughly 17,600 kWh annually which would offset 21% of the entire District’s electric consumption. A summary table of RCEA’s analysis and the potential projects that could be funded by the loan program are shown in Table 2 below.

Table 2 Summary of recommended energy projects for MUSD.

| Recommended Energy Projects | | | | | | | | | | | |
|-----------------------------|---|--------------------------------|---------------------|-------------------------------|---|-------------------------------|----------------------------------|-----------------------------|---|------------------------------------|-------------------------|
| Site | Energy Projects | Project Installation Cost (\$) | Demand Savings (kW) | Annual Electric Savings (kWh) | Total Annual Energy Savings (million btu) | %age of Annual Energy Savings | Project Annual Cost Savings (\$) | Effective Useful Life (EUL) | Total Energy Savings over EUL (million btu) | Project Cost Savings over EUL (\$) | Project Payback (years) |
| Mattole School | 8 kW DC grid-tied solar PV array on library roof | \$28,000 | 1.8 | 11,571 | 124 | 9% | \$2,576 | 20 | 2,480 | \$51,523.49 | 10.87 |
| Honeydew Elementary | 4.8 kW DC grid-tied solar PV array on roof of main classroom building | \$16,800 | 1.1 | 6,028 | 65 | 5% | \$1,484 | 20 | 1,292 | \$29,677.40 | 11.32 |
| Totals | | \$44,800 | 2.9 | 17,599 | 189 | 14% | \$4,060 | 20 | 3,772 | \$81,201 | 11.03 |

The CEC scores each loan application based on the projects overall site energy offset. The loan program also uses each District’s percentage of FRPM as a scoring criterion. Table 3 below shows the MUSD project under the CEC scoring rubric.

Table 3 CEC ECAA-Ed scoring rubric for MUSD energy projects.

| LEA | Free and Reduced-Price Meals Program | | Energy Savings | | Expected Payback Period | Total Score |
|------|--------------------------------------|------------------|---------------------|------------------|-------------------------|-------------|
| | % of FRPM Students | Weighting Factor | % of Baseline Usage | Weighting Factor | | |
| MUSD | 46% | 50% | 14% | 50% | 11.03 | 30.246 |

2 Introduction

2.1 LEA and Site Descriptions

The Mattole Unified School District operates sites located in Petrolia and Honeydew, California with the District Office at 29289 Chambers Rd, Petrolia CA, 95558. The District comprises two sites: Mattole Elementary School, also located on Chambers Rd in Petrolia, CA and Honeydew Elementary School, located at Wilder Ridge Rd, Honeydew, CA, 95545.

2.2 Operating Schedules

Classes through Mattole Unified School District are in session approximately 180 days per year from August 23rd to June 14th. The bell schedule is 8:40 a.m. to 3:05 p.m., Monday through Friday. The teachers and staff typically arrive at or before 8:00 a.m. Students and staff observe several holiday periods per year including Thanksgiving week, a two-week winter break, president holiday week, and spring break. During the summer there are no classes, but staff perform maintenance and prepare for the upcoming school year. Approximately 50 students are currently enrolled in kindergarten through 12th grade.

2.3 Local Weather Statistics

MUSD is located in both Petrolia and Honeydew, California, which are both unincorporated communities in Humboldt County. Mattole Elementary is in Petrolia, CA (latitude 40.33°N, longitude 124.26°W). Honeydew Elementary is in Honeydew, CA (latitude 40.3325°N, longitude 124.14°W). Both Petrolia and Honeydew are situated within CEC Climate Zone 1. The American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE) design conditions (Fundamentals Chapter 14) for this location are 35.0 °F for heating; with 73.0 °F dry-bulb, and 60.0 °F wet-bulb, for cooling. Hourly weather data for both Climate Zone 1 can be obtained from the typical meteorological year set 3 (TMY3) for Arcata Airport (Bin 725945, Bin index 1, CEC climate zone 1). Solar irradiance data for Petrolia and Honeydew, California was obtained from the National Renewable Energy Lab (NREL) PVWatts database.

2.4 Audit Objectives

The objective of this audit was to estimate the feasibility of installing solar PV arrays that could offset the greatest percentage of the MUSD’s electric use from all five meters, on an annual basis. RCEA began working with the Mattole Unified School District as part of RCEA’s Public Agency Solar Program in May of 2018. After an initial kick-off meeting with District staff, RCEA began its analysis of the energy consumption, efficiency opportunities, and solar photovoltaic installation opportunities at Mattole Elementary School and Honeydew Elementary School.

3 Facility Background and Site Description

Mattole Elementary and Honeydew Elementary are both part of The Mattole Unified School District which serves a southern portion of unincorporated Humboldt County, California. The District comprises two sites: Mattole School and Honeydew Elementary School. Mattole School is located at 29289 Chambers Rd, Petrolia CA, 95558, while Honeydew Elementary is situated at Wilder Ridge Rd, Honeydew, CA, 95545. Figure 1 below shows the geographic locations of both sites.

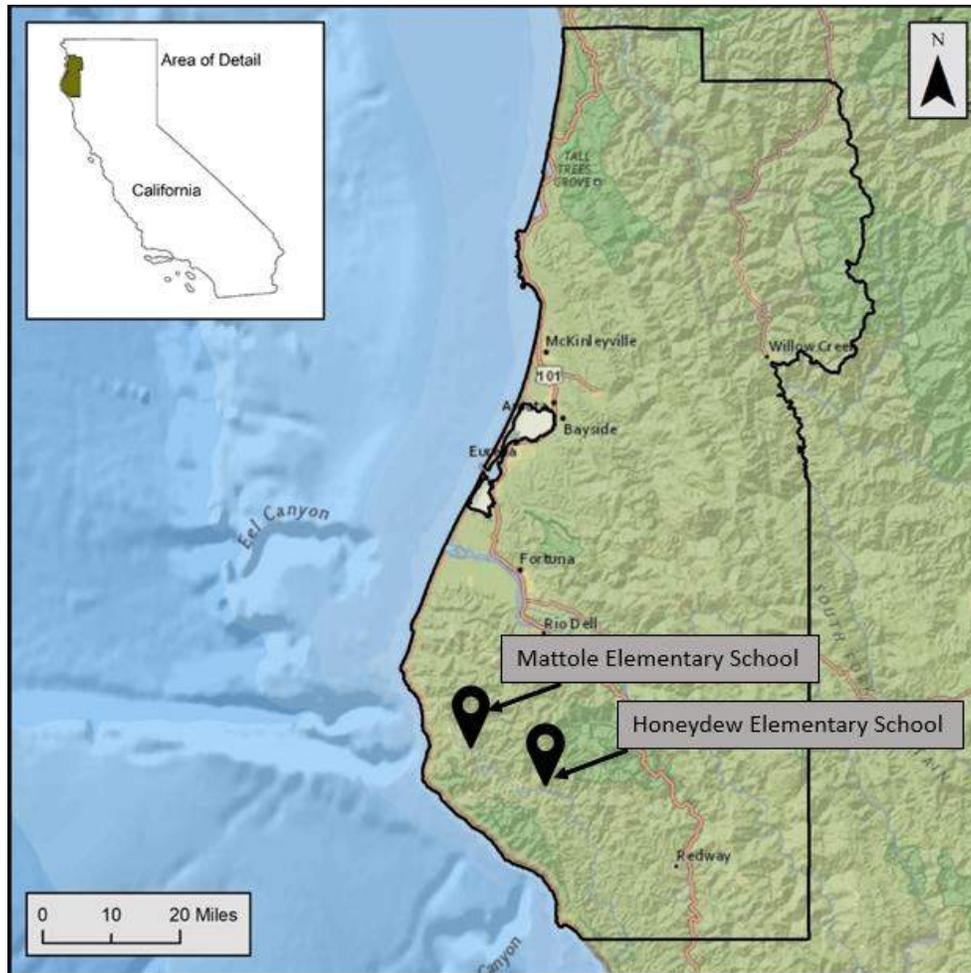


Figure 1 Mattole School and Honeydew Elementary locations in Humboldt County CA, CEC Climate Zone 1.

3.1 Mattole School

Mattole School is located within an unincorporated area of Humboldt County, alongside the Mattole river in Petrolia, CA. RCEA has worked with the Mattole School to implement energy efficiency projects through California’s Proposition 39 program. The T-8 linear fluorescent light fixtures were upgraded to LED lighting throughout the Mattole Campus in 2016 and 2017. As a result, the Mattole site used 16% less electricity in 2017-18 compared to the benchmarked electrical use data from 2014-15. Within the Mattole campus there are 4 electric meters. Figure 2 below show the parcel boundary for Mattole School, as well as, the meter locations indicated in red markers.



Figure 2 Mattole School, in Petrolia, CA.

3.1.1 Mattole Facility Description

Mattole School consists of eight buildings, including one portable used for storage. The eight buildings on campus are all single story and consist of 3 sets of classrooms, an office, a multipurpose room, a student lounge, storage, and a library. Figure 3 displays the layout of Mattole’s campus. Figure 2 above is taken from the Humboldt County GIS system and is included to show the site’s Parcel boundary. Figure 3 below is a satellite image of the same site taken from Google Earth; the image in Figure 3 has been updated more recently than the County’s Parcel map shown in Figure 2. Figure 3 includes the new classrooms that were constructed in 2018.

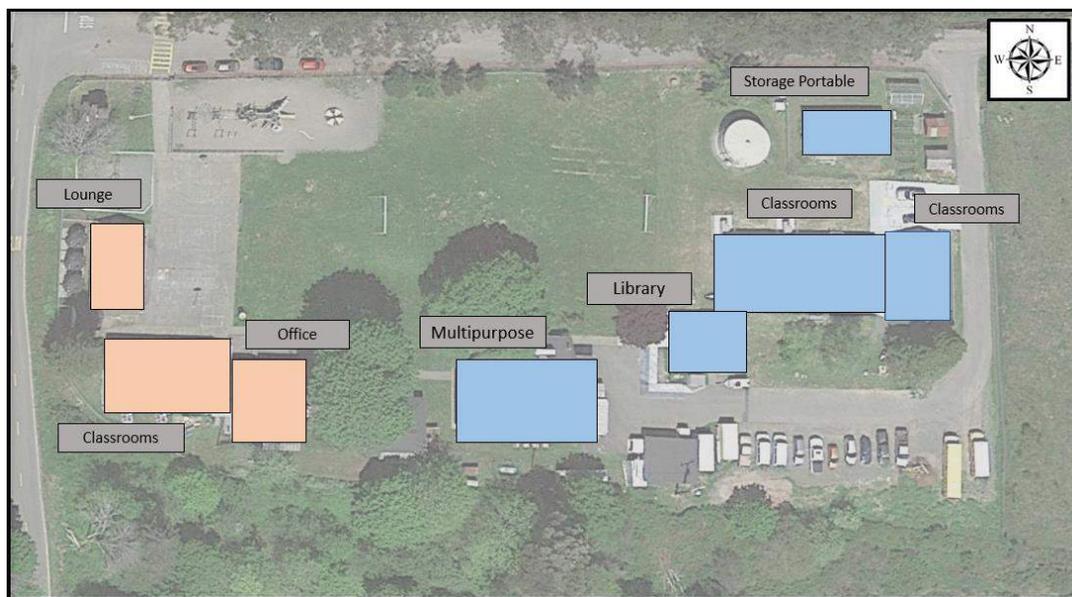


Figure 3 Facility layout of Mattole School.

3.2 Honeydew Elementary School

Honeydew Elementary School is located within an unincorporated area of Humboldt County, 28 miles southeast of Petrolia, CA. RCEA has worked with the Honeydew Elementary School to implement energy efficiency projects through California’s Proposition 39 program. The T-8 linear fluorescent light fixtures were upgraded to LED lighting throughout the Honeydew campus in 2016 and 2017. During this time Honeydew Elementary has seen a reduction in number of classrooms used and hours of operation of other classrooms. As a result of the reduced operations and the efficiency work, the Honeydew site used 55% less electricity in 2017-18 compared to the benchmarked electrical use from 2014-15. A single electric meter serves all of Honeydew Elementary School. Figure 4 shows the Honeydew campus with the meter location indicated with a red marker.



Figure 4 Honeydew Elementary School’s meter location.

3.2.1 Honeydew Facility Description

Honeydew Elementary School’s campus contains of one single story building, a single story portable, and one storage shed. The main building on campus is consists of classrooms and a small office. The portable contains additional class space. Figure 5 below displays the layout of Honeydew’s campus.



Figure 5 Facility layout of Honeydew Elementary School.

4 Energy Using Systems

Mattole Unified School District utilizes electricity and natural gas to meet its energy needs. Both Mattole and Honeydew's primary energy source is electricity which provides 71% of the MUSD's annual energy use; propane provides 29% of the MUSD's annual energy use. Mattole School and Honeydew Elementary use propane-fired equipment that typically is fueled by natural gas. The specific equipment within the school fueled by propane consists of packaged HVAC units, water storage heaters, and kitchen equipment.

4.1 Lighting Systems

RCEA worked with the MUSD to implement energy efficiency projects through California's Proposition 39 program. The T-8 linear fluorescent light fixtures were upgraded to LED lighting throughout the Mattole and Honeydew campuses in 2016 and 2017. Mattole Elementary used 16% less electricity in 2017-18 compared to the benchmarked electrical use data from 2014-15. Honeydew Elementary has seen a reduction in number of classrooms used and hours of operation of other classrooms. As a result of the reduced operations and the efficiency work, the Honeydew site used 55% less electricity in 2017-18 compared to the benchmarked electrical use from 2014-15.

4.2 Heating, Ventilation, and Air Conditioning (HVAC)

HVAC equipment at the Honeydew site consists of four (4) propane-fired, packaged and split units. HVAC equipment at the Mattole site consists of seven (7) propane-fired, packaged and split units; as well as four (4)

electric heat pump units. In 2016-2017, four packaged heat pumps serving the elementary classrooms at Mattole School were upgraded to high efficiency heat pump units as part of their Proposition 39 work.

4.3 Domestic Hot Water

The Honeydew site is served by a single, propane-fired, 30-gallon storage water heater. The Mattole site is served by three (3) propane-fired storage water heaters; one (1) 30-gallon unit and two (2) 50-gallon units.

4.4 Office Equipment and Plug Loads

Like many sites, office equipment and plug loads represent the remaining energy using systems at MUSD. These loads represent a small fraction of the total energy used on site.

5 Existing Energy Use

RCEA performed an audit of Mattole’s and Honeydew’s electricity and propane consumption using utility data from the previous 12 months, covering the period from May 2018 to April 2019. Both Mattole School and Honeydew Elementary receive electric transmission and distribution services from PG&E and are enrolled in RCEA’s Community Choice Energy, a Community Choice Aggregation program that provides the electrical power content. RCEA’s current grid mix is 44% renewables, meaningfully higher than PG&E’s grid mix of 33% renewables. The MUSD sites are served by 5 electric meters, four serving the Mattole campus and the one serving the Honeydew campus. All five meters for MUSD are on an A-1 time-of-use electric rate.

5.1 Site Annual Electric Usage.

RCEA performed an electric load analysis of Mattole’s and Honeydew’s electric consumption using utility data from the previous 12 months, covering the period from May 2018 to April 2019. Table 4 below shows the monthly electric consumption for Mattole School’s four meters and Honeydew Elementary School’s single meter.

Table 4 Monthly electric consumption at all individual meters for MUSD from May 2018 to April 2019.

| Month | Triple JR High School (kWh) | MUSD (kWh) | Mattole Elementary School (kWh) | Triple JT Highschool (kWh) | Honeydew Elementary (kWh) | Total Electric Load (kWh) |
|---------------|-----------------------------|---------------|---------------------------------|----------------------------|---------------------------|---------------------------|
| May-18 | 1734 | 82 | 3291 | 41 | 352 | 5500 |
| Jun-18 | 1506 | 192 | 3194 | 107 | 437 | 5436 |
| Jul-18 | 958 | 160 | 2005 | 270 | 460 | 3853 |
| Aug-18 | 804 | 13 | 2329 | 46 | 567 | 3759 |
| Sep-18 | 1355 | 17 | 3714 | 249 | 515 | 5850 |
| Oct-18 | 1662 | 22 | 3667 | 67 | 456 | 5874 |
| Nov-18 | 2850 | 0 | 4620 | 46 | 436 | 7952 |
| Dec-18 | 3004 | 400 | 4944 | 43 | 493 | 8884 |
| Jan-19 | 3426 | 2720 | 3560 | 14 | 476 | 10195 |
| Feb-19 | 3519 | 2080 | 4814 | 20 | 390 | 10823 |
| Mar-19 | 3081 | 2720 | 3927 | 16 | 446 | 10190 |
| Apr-19 | 2435 | 1760 | 3537 | 353 | 373 | 8458 |
| Totals | 26,334 | 10,166 | 43,601 | 1,271 | 5401 | 86,773 |

Table 5 and Figure 6 below show summaries of the annual electric consumption across the two sites analyzed in this report. For Mattole School and Honeydew Elementary School, the results show greater electric use in the winter months due to longer operating schedules and an increased need for lighting due to shorter days in winter.

Table 5 Summary of annual electric use and costs at Mattole Unified School District.

| MUSD Electricity Use Summary | | | | | | | |
|-----------------------------------|--------------------------------|------|-------------------|---------------------|---------------------|---------------------|---------------|
| Site Name | Address | Rate | Annual Load (kWh) | Percent of Load (%) | Annual Charges (\$) | Percent Charges (%) | Cost/kWh (\$) |
| Mattole School | 29289 Chambers Rd, Petrolia CA | HA1X | 81372 | 94% | \$ 18041 | 93% | 0.21 |
| Honeydew Elementary School | Wilder Ridge Rd, Honeydew, CA | HA1X | 5401 | 6% | \$1329.58 | 7% | 0.25 |
| Totals | | | 86773 | 100% | \$19370.67 | 100% | 0.22 |

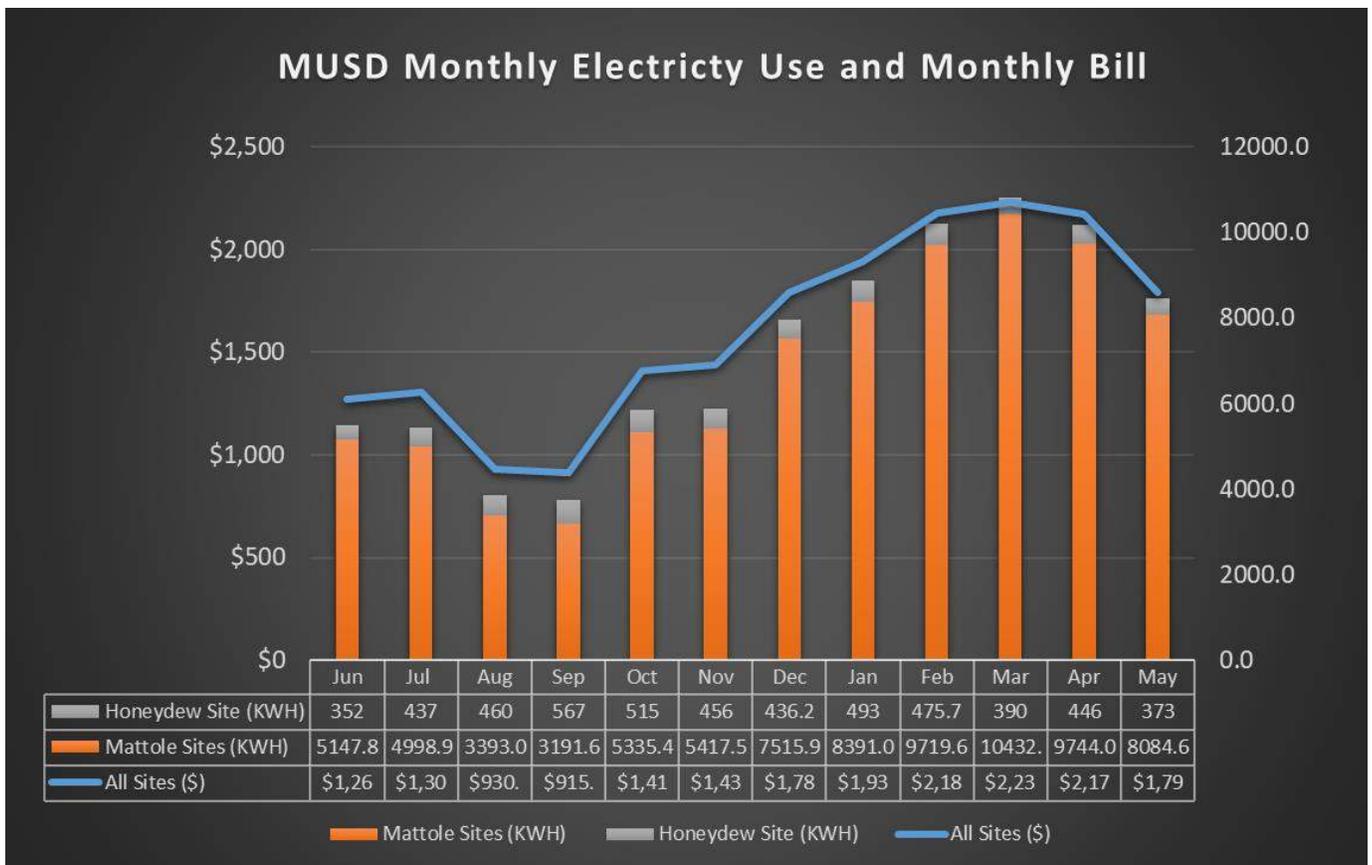


Figure 6 Monthly electric use and costs at Mattole Unified School District.

5.2 Site Annual Propane Use

Both Mattole School and Honeydew Elementary School use liquified propane gas for all their gas-fired appliances. RCEA performed an audit of MUSD’s propane consumption using utility data from the previous 12 months, covering the period from April 2018 to March 2019. Table 6 below shows the monthly propane consumption for Mattole Unified School District. Propane fuel is purchased and stored at specific times based on tank levels, this results in some months with no propane purchases and show as zeros in the consumption data for some months of the year.

Table 6 Monthly electric load for Mattole Unified School District's five meters.

| Month | Mattole Propane Consumption (gal) | Mattole Gas Cost (\$) | Honeydew Propane Consumption (gal) | Honeydew Gas Cost (\$) | Total Propane Consumption (gal) | Total Gas Cost (\$) |
|---------------------|-----------------------------------|-----------------------|------------------------------------|------------------------|---------------------------------|---------------------|
| Apr-18 | 275.8 | \$733.15 | 200 | \$542.50 | 475.8 | \$1,275.65 |
| May-18 | 0 | \$0.00 | 0 | \$0.00 | 0 | \$0.00 |
| Jun-18 | 241.3 | \$602.16 | 0 | \$0.00 | 241.3 | \$602.16 |
| Jul-18 | 0 | \$118.08 | 0 | \$0.00 | 0 | \$118.08 |
| Aug-18 | 0 | \$80.10 | 0 | \$0.00 | 0 | \$80.10 |
| Sep-18 | 241.5 | \$623.62 | 0 | \$0.00 | 241.5 | \$623.62 |
| Oct-18 | 0 | \$0.00 | 0 | \$118.08 | 0 | \$118.08 |
| Nov-18 | 572.6 | \$1,609.08 | 147.1 | \$413.37 | 719.7 | \$2,022.45 |
| Dec-18 | 422.7 | \$1,187.85 | 0 | \$0.00 | 422.7 | \$1,187.85 |
| Jan-19 | 753.9 | \$2,118.56 | 209.2 | \$587.89 | 963.1 | \$2,706.45 |
| Feb-19 | 502.8 | \$1,440.22 | 140.1 | \$401.30 | 642.9 | \$1,841.52 |
| Mar-19 | 455.1 | \$1,303.59 | 0 | \$0.00 | 455.1 | \$1,303.59 |
| Annual Total | 3465.7 | \$9,816.41 | 696.4 | \$2,063.14 | 4470.3 | \$12,722.23 |

Figure 7 below represents of the monthly propane use and costs for MUSD, the data shows that a majority of the site's propane usage occurs in the winter months.

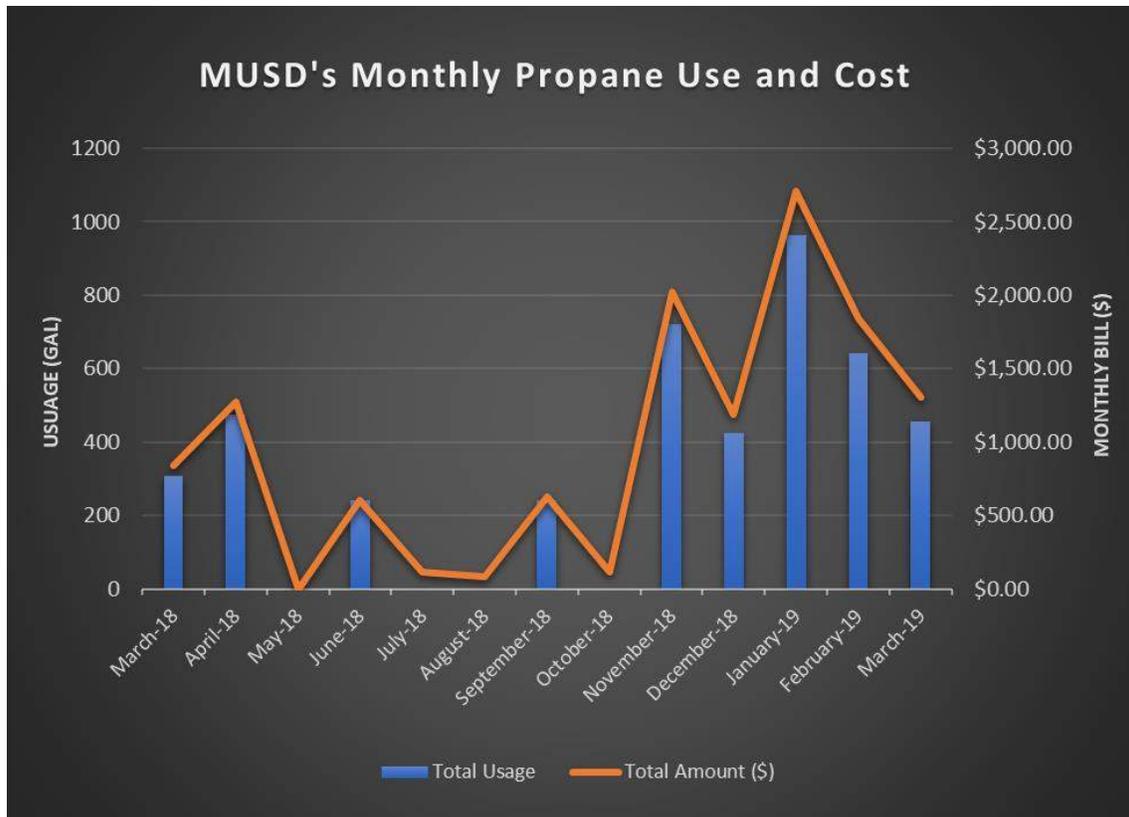


Figure 7 Monthly propane use and cost for Mattole Unified School District.

5.3 Energy Use Patterns

The monthly electricity and natural usage fluctuate alongside changes in school operation and monthly air temperature. Due to the location in Climate Zone 1, during the summer months both Mattole and Honeydew experience moderate summer temperatures coupled with low hours of operation, so there is a minimized need for cooling energy during the typical cooling season. The highest energy usages are observed from December to April due to the cold temperature throughout the fall, winter and spring seasons. As a result, the monthly energy profile above shows high propane heating usage during the months of and around the winter heating season (November to February).

5.4 Energy Balance

Mattole Unified School District utilizes electricity and propane to meet its energy needs. Both Mattole and Honeydew’s primary energy source is electricity which provides 71% of the MUSD’s annual energy use; propane provides 29% of the MUSD’s annual energy use. Table 7 below shows a summary of MUSD’s energy use and cost by fuel type.

Table 7 Energy use and cost by fuel type at Mattole Unified School District.

| Baseline Energy Use and Cost | | | | | | | | | | | |
|------------------------------|---------------|--------------------|--------------------|------------|--------------|--------------------|--------------------|------------|---------------------------------|--------------------|----------------------------|
| Site | Electricity | | | | Propane | | | | Total | | |
| | kWh/yr | \$/yr | BTU/ yr | %BTU/ Fuel | therm/ yr | \$/yr | BTU/ yr | %BTU/ Fuel | Annual Energy Use (Million BTU) | Annual Cost \$/yr | Site Comparison %BTU/ Site |
| Mattole School | 81,327 | \$18,041.09 | 871,981,656 | 73% | 3,466 | \$9,816.41 | 320,577,250 | 27% | 1,192.6 | \$27,857.50 | 91% |
| Honeydew Elementary | 5,401 | \$1,329.58 | 57,876,044 | 47% | 696 | \$2,063.14 | 64,417,00 | 53% | 122.3 | \$3,392.72 | 9% |
| Total | 86,773 | \$19,370.67 | 929857700.4 | 71% | 4,162 | \$11,879.55 | 384,994,250 | 29% | 1,314 | \$31,250.22 | 100% |

While electricity accounts for 71% of MUSD’s energy use, Figure 8 below shows that electricity accounts for only 62% of the MUSD’s total annual energy cost.

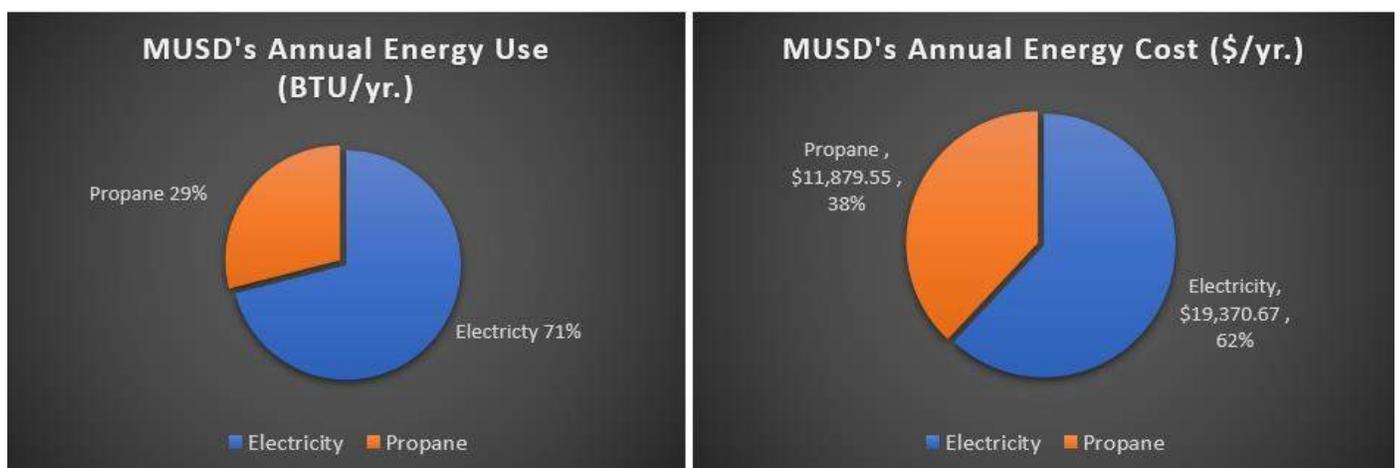


Figure 8 MUSD’s energy use balance by fuel type.

5.5 Rate Simulation and Analysis of Rate Schedules

Both Mattole School and Honeydew Elementary School receive electric transmission and distribution services from PG&E and are enrolled in RCEA’s Community Choice Energy, a Community Choice Aggregation program

that provides the generation portion of the electrical power content. The MUSD sites are served by five metered electric accounts, one serving the Mattole campus with four meters and one serving the Honeydew campus with one meter. All five MUSD meters are on an A-1 time-of-use electric rate. Table 8 below shows the A-1 time-of-use rate, including seasons, time-of-use periods, PG&E’s transmission and distribution rates, RCEA’s generation rates, and the totaled A-1 rates that were used in this analysis.

Table 8 Time of Use rate for Mattole Unified School District’s five meters.

| A-1 Time of Use Electric Rates | | | | | | |
|--------------------------------|---------------|---------------|-----------------|---------|---------------------|-------------------------------------|
| Season | PG&E T&D Rate | RCEA Gen Rate | Total A-1 Rates | Months | Days | Time |
| Summer Peak | \$0.128210 | \$0.135645 | \$0.263855 | May-Oct | Mon-Fri | 12pm-6pm |
| Summer Part-Peak | \$0.128210 | \$0.112704 | \$0.240914 | May-Oct | Mon-Fri | 8:30am-12:00pm AND 6:00pm-9:30pm |
| Summer Off-Peak | \$0.128210 | \$0.086175 | \$0.214385 | May-Oct | Mon-Fri Sat- Sun | 9:30pm-8:30am All Day |
| Winter Part-Peak | \$0.110270 | \$0.112520 | \$0.222790 | Nov Apr | Mon-Fri | 8:30am-9:30pm |
| Winter Off-Peak | \$0.110270 | 0.0922276 | \$0.110270 | Nov Apr | Mon-Fri Sat- Sun | 9:30pm-8:30am All Day |

6 Audit Activity and Results

RCEA performed a detailed solar site analysis at the MUSD sites on September 27, 2018. The purpose of the audit was to determine the feasibility of installing a solar photovoltaic array at Mattole School capable of offsetting 14% of the electrical load onsite and a solar PV array at Honeydew Elementary School that would be capable of offsetting 110% of the existing electric load on site. Together the two solar PV arrays could offset 21% of the total electrical load for Mattole Unified School District. RCEA’s audit activities and results are detailed below.

6.1 Solar Photovoltaic (PV) Site Analysis

The Library, situated at the east end of the Mattole campus, is a single-story structure with a shingle roof; the roof is in good condition. The roof’s ridgeline runs west to east providing a south facing installation area with few roofing penetrations. The south face of the roof is oriented due south (180°) with a 6-in-12 (26.5°) pitch. A shading analysis was performed on the Library using a Solar Pathfinder tool which showed the total annual shading to be about 4%. If the entire south face of the Library roof were utilized for a solar installation, there would be about 500 square feet available to host a PV array. Figure 9 below shows the available areas for a PV installation on the library roof outlined in blue. The Library would have enough open space to contain a PV array with an output of 8 KW DC. This production could offset 14% of the electrical use and 14% of the annual bills for all four of Mattole’s meters.



Figure 9 Available roof area for solar PV installation at Mattole School.

The main building within the Honeydew campus is a single-story structure with a shingle roof. The roof's ridgeline runs southwest to northeast providing a modest southeast facing installation area with few roofing penetrations. The roof is in good condition, however RCEA staff noticed potential damage to a small portion of the northwest roof face, opposite the proposed PV installation location. RCEA recommends that MUSD have a qualified professional assess this irregularity. The ideal face of the roof is oriented (135°) southeast with a 6-in-12 (26.5°) pitch and has enough open space to host a solar PV array that could offset 112% of the electrical use and 110% of the annual bills for the site. A shading analysis was performed using a Solar Pathfinder tool which showed that the total annual shading at this location is about 10%. California Fire Marshal guidance for solar PV installations require 4' setbacks from gable ends and ridges of the roof. After accounting for shading effects and Fire Marshal setbacks the available area for a solar PV array would be approximately 700 square feet. Figure 10 below shows the available area for a PV installation on the roof outlined in blue.



Figure 10 Available roof area for solar installation at Honeydew Elementary School.

Figure 11 below shows the area of concern on the northwest roof face of the main classroom building.



Figure 11 Potential roof damage on northwest face of the roof at Honeydew Elementary School.

6.2 Solar Photovoltaic (PV) System Size

RCEA has provided two project analyses for Mattole Unified School District. The Mattole School analysis looked at the largest array that would fit on the library’s roof, allowing for a solar PV project which would offset 14% of the electric use over the previous 12 months. The Honeydew solar PV project is based on the maximum system size allowed by PG&E which would be 110% of the electric consumption over the previous 12 months. This would allow the PV project to achieve the greatest possible offset of existing combined site energy and would accommodate the new electric loads from future fuel switching projects. Due to the small size of the proposed solar array at Honeydew Elementary School, a single additional solar panel brings the electrical offset to 112% and the annual bill offset to 112% for the previous 12 months. The two projects considered together will offset 21% of MUSD’s electrical use over the previous 12 months.

RCEA estimates that an 8 kW DC PV array would offset approximately 14% of the electric consumption from all four meters at Mattole School and 14% of Mattole’s electric bills, based on the most recent 12 months of utility data. The assumptions and inputs used in RCEA’s solar PV system sizing calculations can be found in the Methodology section of this document. Figure 12 below shows the estimated electric usage and solar PV production under the above assumptions. Table 9 below displays Mattole School’s electric usage from the previous 12 months of data and the estimated PV production, under the same assumptions as stated above.

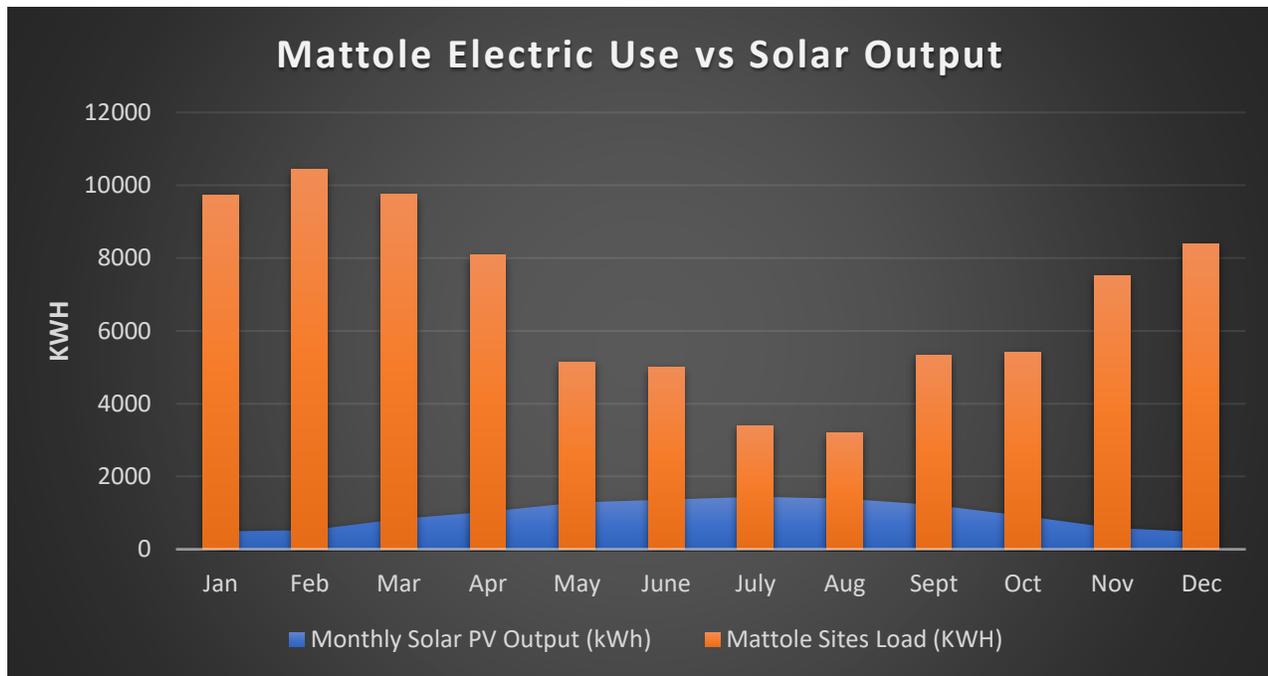


Figure 12 Monthly electric use versus solar PV output for proposed solar project at Mattole School.

Table 9 Monthly electric load versus monthly solar PV output for Mattole School.

| Month | Monthly Solar PV Output (kWh) | Mattole School Load (kwh) |
|---------------|-------------------------------|---------------------------|
| Jan | 489 | 9720 |
| Feb | 527 | 10433 |
| Mar | 836 | 9744 |
| Apr | 1032 | 8085 |
| May | 1285 | 5148 |
| June | 1368 | 4999 |
| July | 1445 | 3393 |
| Aug | 1392 | 3192 |
| Sept | 1215 | 5335 |
| Oct | 919 | 5418 |
| Nov | 588 | 7516 |
| Dec | 477 | 8391 |
| Totals | 11,571 | 81,372 |

RCEA estimates that a 4.8 kW DC PV array would offset approximately 112% of the electric consumption of the single meter at Honeydew Elementary School and 112% of Honeydew’s electric bills, based on the most recent 12 months of utility data. The assumptions and inputs used in RCEA’s solar PV system sizing calculations can be found in the Methodology section of this document. Figure 13 below shows the estimated electric usage and solar PV production under the above assumptions. Table 10 below displays Honeydew Elementary School’s electric usage from the previous 12 months of data and the estimated PV production, under the same assumption as stated above.

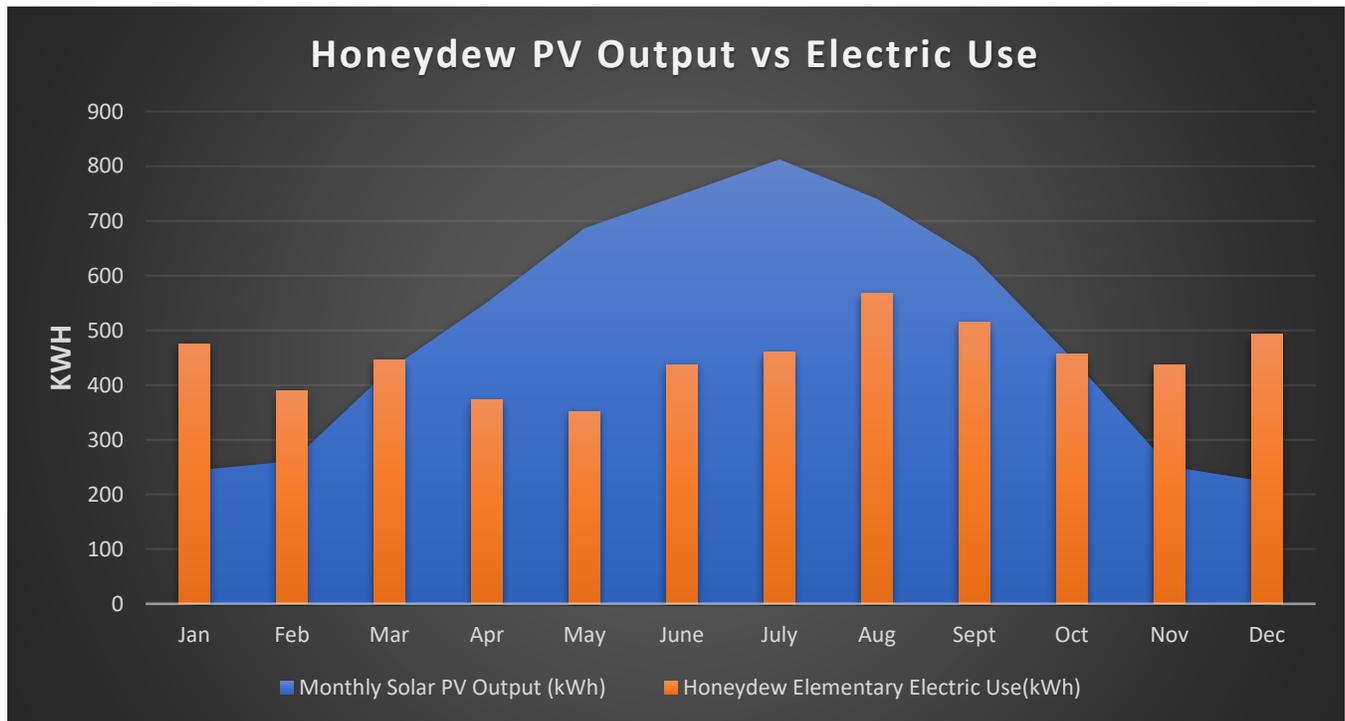


Figure 13 Monthly electric use versus solar PV output at Honeydew Elementary School.

Table 10 Monthly electric load versus solar PV output for Honeydew Elementary School.

| Month | Monthly Solar PV Output (kWh) | Honeydew Elementary Load (KWH) |
|---------------|-------------------------------|--------------------------------|
| Jan | 244 | 476 |
| Feb | 261 | 390 |
| Mar | 428 | 446 |
| Apr | 551 | 373 |
| May | 686 | 352 |
| June | 749 | 437 |
| July | 812 | 460 |
| Aug | 740 | 567 |
| Sept | 633 | 515 |
| Oct | 449 | 456 |
| Nov | 251 | 436 |
| Dec | 223 | 493 |
| Totals | 6028 | 5401 |

Together the Mattole and Honeydew solar PV arrays would total to 12.8 kw DC. RCEA estimates that an array of this size would offset MUSD’s electrical load by 20% and would lead to a bill offset of 21%, according to the last 12 months of data. The two arrays would add up to 12.8 kW DC and would produce about 17,600 kWh AC annually for MUSD. With an average electricity price of \$0.22 per kWh, the annual production 17,600 kWh AC from the two arrays would save MUSD over \$4,000 within the first year. Table 11 below shows a combined summary of the two proposed solar PV systems including system size, annual production estimate, and first year energy savings.

Table 11 Summary of Combined 12.8 kW DC solar PV system for MUSD.

| PV Systems Summary | |
|-----------------------------------|------------|
| PV System Size (kW DC) | 12.8 |
| Estimated Cost of Systems | \$44,800 |
| Annual Energy Production (kWh AC) | 17,599 |
| First Year Energy Savings (\$) | \$4,060.04 |

6.3 System Cost

RCEA has recent history with solar PV installations for public works projects through California’s Proposition 39 program. The average installed price of a PV system, including all labor, materials, engineering, permitting and design has been about \$3.50/DC watt. This would yield a system cost of approximately \$44,800. Table 12 below shows a break-down of the combined estimated costs for the proposed PV systems.

Table 12 Estimated costs for a 12.8 kW DC solar PV array for MUSD.

| PV Systems Cost Estimate | |
|--|------------------|
| PV Modules | \$ 11,200 |
| Inverters | \$ 5,824 |
| Electrical/Structural Balance of Systems | \$ 6,720 |
| Labor | \$ 8,960 |
| Engineering and Design | \$ 4,480 |
| Permitting and Interconnection | \$ 1,344 |
| Overhead and Profit | \$ 6,272 |
| Total Cost | \$ 44,800 |

6.4 Audit Results

Based on the analysis of the two potential project options described in this report, RCEA finds that a solar PV installation at Mattole School and at Honeydew Elementary School are possible and would likely meet all the requirements of the CEC’s Energy Conservation Assistance Act Educational Subaccount (ECAA-Ed) program for eligible renewable energy projects. Combined the proposed projects would offset an estimated 189 million BTUs of MUSD’s energy, roughly 14% of the MUSD’s total annual energy use. The projects would produce an annual energy cost savings of \$4,060; over 20 years the project cost savings would be approximately \$81,201. The project has a simple payback period of 11.03 years. Table 13 below shows a summary of project metrics for the Mattole solar project and the Honeydew solar project.

Table 13 Summary of project metrics for the Mattole solar project and the Honeydew Solar Project.

| Recommended Energy Projects | | | | | | | | | | | |
|-----------------------------|---|--------------------------------|---------------------|-------------------------------|---|-------------------------------|----------------------------------|-----------------------------|---|------------------------------------|-------------------------|
| Site | Energy Projects | Project Installation Cost (\$) | Demand Savings (kW) | Annual Electric Savings (kWh) | Total Annual Energy Savings (million btu) | %age of Annual Energy Savings | Project Annual Cost Savings (\$) | Effective Useful Life (EUL) | Total Energy Savings over EUL (million btu) | Project Cost Savings over EUL (\$) | Project Payback (years) |
| Mattole School | 8 kW DC grid-tied solar PV array on library roof | \$28,000 | 1.8 | 11,571 | 124 | 9% | \$2,576 | 20 | 2,480 | \$51,523.49 | 10.87 |
| Honeydew Elementary | 4.8 kW DC grid-tied solar PV array on roof of main classroom building | \$16,800 | 1.1 | 6,028 | 65 | 5% | \$1,484 | 20 | 1,292 | \$29,677.40 | 11.32 |
| TOTAL | | \$44,800 | 2.9 | 17,599 | 189 | 14% | \$4,060 | 20 | 3,772 | \$81,201 | 11.03 |

The CEC scores each loan application based on the combined overall energy offset. The loan program also uses each District’s percentage of FRPM as a scoring criterion. Table 14 below shows the MUSD project under the CEC scoring rubric.

Table 14 CEC’s ECAA-Ed loan scoring rubric for the Ridgewood Solar Project.

| LEA | Free and Reduced-Price Meals Program | | Energy Savings | | Expected Payback Period | Total Score |
|-------------|--------------------------------------|------------------|---------------------|------------------|-------------------------|---------------|
| | % of FRPM Students | Weighting Factor | % of Baseline Usage | Weighting Factor | | |
| MUSD | 46% | 50% | 14% | 50% | 11.03 | 30.246 |

To meet the CEC loan application requirements Mattole Unified School District signed a board resolution stating their intent to apply for the CEC ECCA-ED loan in the amount of \$44,800. Additionally, the MUSD board signed a CEQA resolution stating that the Mattole and Honeydew projects are exempt from CEQA using the Categorical Exemption for Existing Construction.

RCEA provided the required technical feasibility study submitted with the loan. If the District is awarded the loan, there will be a 30-day period to decide whether to accept the loan. If MUSD accepts the loan, RCEA will continue to provide administrative, technical, and contracting assistance throughout the project.

6.5 Audit Methodology

For Mattole Unified School District, RCEA analyzed the largest PV system size that could fit on the library’s roof at Mattole School, as well as, the required PV system size to offset 110% of the kWh consumed at Honeydew Elementary School. RCEA downloaded insolation data from PV Watts for global horizontal irradiance on a flat plane. Table 15 below shows the insolation data for both Mattole and Honeydew on a horizontal plane; Table 16 shows insolation at an azimuth of 180° on a surface tilted to 26.5°.

Table 15 Average global horizontal irradiance on a flat plane for MUSD sites.

| Monthly Average Daily Insolation for Petrolia, CA (Lat, Lon: 40.33, -124.26, from PV Watts) | | | | | | | | | | | | | |
|---|------|------|------|------|------|------|------|------|------|------|------|------|---------|
| Month | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec | Average |
| Average Insolation (kW/m ² /day) | 1.75 | 2.36 | 3.71 | 5.18 | 6.69 | 7.63 | 7.68 | 6.90 | 5.58 | 3.64 | 2.16 | 1.63 | 4.58 |

Table 16 Average global horizontal irradiance at azimuth 180 degrees and a tilt of 26.5 degrees.

| Average Daily Insolation for Petrolia, CA at 180° azimuth and tilt of 26.5° | | | | | | | | | | | | | |
|---|------|------|------|------|------|------|------|------|------|------|------|------|---------|
| Month | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec | Average |
| Average Insolation (kW/m ² /day) | 2.51 | 3.00 | 4.29 | 5.47 | 6.59 | 7.25 | 7.41 | 7.14 | 6.44 | 4.71 | 3.12 | 2.45 | 5.04 |

Table 17 below shows the inputs and assumptions used in RCEA’s PV system sizing.

Table 17 Mattole USD PV System Sizing Inputs

| Ridgewood PV System Sizing Inputs | |
|--|---------|
| Array Orientation (Degrees) | 180 |
| Array Tilt (Degrees) | 26.5 |
| Average Daily Insolation (kWh/m ² /day) | 5.04 |
| Inverter Efficiency (%) | 97% |
| De-rate Factor (Soiling, Wire Loss, Mismatch) (%) | 10% |
| Shading | 4% |
| Average Operating Cell Temperature (°C) | 47 |
| Temperature Coefficient of Power (Wp/°C) | -0.0037 |
| Module DC Rating (Watts) | 320 |
| Manufacturer Power Guarantee (%) | 98% |

RCEA’s system sizing methodology is adopted from and detailed in *Photovoltaic Systems* by James Dunlop. Module specs are based on Q-Cell Peak-G5 320-watt modules. Inverter efficiency and MPPT efficiency are based on a SMA-TL-US inverter. The equations below outline the system sizing process; tables 16 and 17 show the actual values used in the calculations.

RCEA’s system sizing methodology starts with the daily energy production goal, derived by dividing the total, annual kWh consumed on site by 365. RCEA uses a “peak sun hours” method of system sizing where 1000 watts/m²/day is one “peak sun hour” corresponding to the Standard Test Conditions (STC) under which the solar modules are given their name-plate rating (Solar Energy International, 2013). This is divided by the average daily insolation to estimate a required inverter AC output (EQ 1).

Daily Energy Production Goal (kWh)

$$\text{Avg. daily insolation} \frac{\text{kWh}}{\text{m}^2 \times \text{day}}$$

= **Required Inverter AC Output (kW)**

EQ 1

The output is then de-rated for inverter efficiency to estimate the required array DC output in kW (EQ 2).

$$\frac{\text{Inverter AC Output (kW)}}{\left(\frac{\text{Inverter Efficiency}}{\text{Max Power point tracking Efficiency}}\right)}$$

= **Required Array DC Power Output (kW)** EQ 2

A further de-rating (10%-14%) is applied to account for module mismatch, soiling, wire loss, shading and other system losses (EQ 3).

$$\frac{\text{Required Array Output (kW)}}{1 - (\text{Derate Factor} + \text{Shading})}$$

= **Required Temp. Corrected Array Power Output** EQ 3

This is further de-rated by accounting for temperature corrected output at nominal operating cell temperature of 40° C for coastal regions and 47°C for inland regions of Humboldt County and again de-rated based on the module manufacturer’s power guarantee (EQ 4).

$$\frac{(\text{Temp. Corrected Array Power Output})}{(1 + 1 \times \text{Temp. Coefficient of Power} \times (\text{Avg. Operating Temp. (°C)} - 25))}$$

= **Required Array Guaranteed Power Output (kW)** EQ 4

An estimate of the required number of modules for the PV array can be generated using the required array guaranteed power output, the manufacturer power guarantee and the individual module DC rating (EQ 5). This value is always rounded up to the nearest whole number of modules.

$$\frac{\frac{\text{Required Array Guaranteed Power Output}}{\text{Manufacturer Power Guarantee (\%)}}}{(\text{Module DC Rating (Watts)}/1000)}$$

= **Number of Modules in Array** EQ 5

Multiplying the module DC rating by the number of modules in the array yields the total DC system size (EQ 6).

$$\frac{(\text{Module DC Rating (Watts)} \times \text{Number of Modules in Array})}{1000}$$

= **DC System Size (kW)** EQ 6

Table 18 shows the values used to estimate a DC system size of 8 kW for Mattole School’s solar PV project. This is provided for context, supporting spreadsheets contain complete calculations.

Table 18 Example of RCEA's solar PV system sizing.

| DC System Size Based on Annual Electric Load | |
|--|-------------|
| Average Daily Insolation (kWh/m ² /day) | 5.04 |
| Daily Energy Production Goal (kWh) | 30.10 |
| Required Inverter AC Output (kW) | 5.97 |
| | |
| Inverter Efficiency | 0.97 |
| Maximum Power Point Tracking Efficiency | 1.00 |
| Required Array DC Output (kW) | 6.15 |
| | |
| De-rate Factor (Soiling, Wire Loss, Mismatch) (%) | 0.14 |
| Required Temp Corrected Array Power Output | 7.16 |
| | |
| Average Operating Temperature (°C) | 47.00 |
| Temperature Coefficient of Power (/°C) | -0.0037 |
| Required Array Guaranteed Power Output | 7.80 |
| | |
| Module DC Rating (Watts) | 320.00 |
| Manufacturer Power Guarantee (%) | 0.98 |
| Number of Modules in Array | 25.00 |
| | |
| DC System Size (kW) | 8.00 |

Multiplying the module DC rating, the manufacturer power guarantee, and the number of modules in the array yields the array guaranteed power output (EQ 7).

$$\frac{(\text{Module DC Rating (Watts)} \times \text{Manufacturer Power Guarantee (\%)} \times \text{Number of Modules in Array})}{1000}$$

= Array Guaranteed Power Output (kW) EQ 7

To account for the effect of temperature on power output, the temperature coefficient of power is applied to the array guaranteed power output (EQ 8).

$$\text{Array Guaranteed Power Output (kW)} + (\text{Array Guaranteed Power Output (kW)} \times \text{Temperature Coefficient of Power (\%/}^\circ\text{C)} \times (\text{Average Operating Temperature (}^\circ\text{C)} - 25))$$
 EQ 8

= Temp. Corrected Array Power Output (kW)

Derating for soiling, wire loss, and mismatch yields the net array DC output (EQ 9).

$$\begin{aligned} & \text{Temp Corrected Array Power Output (kW)} \\ & - (\text{Temp Corrected Array Power Output (kW)} \\ & \times \text{Derate Factor (Soiling, Wire loss, Mismatch)}) \end{aligned}$$

= Net Array DC Output EQ 9

Further derating for inverter efficiency and maximum power point tracking efficiency results in inverter AC output (EQ 10).

Net Array DC Output × Inverter Efficiency × Maximum Power Point Tracking Efficiency

= Inverter AC Output EQ 10

Daily energy production can then be found by multiplying the inverter AC output by the average daily insolation at the site (EQ 11).

Inverter AC Output × Average Daily Insolation

= Daily Energy Production (kWh) EQ 11

Annual energy production is then found by multiplying the daily energy production (kWh) by the number of days per year (EQ 12).

Daily Energy Production (kWh) × 365 Days/Year

= Annual AC Energy Production (kWh) EQ 12

Table 19 shows the values used to estimate the annual AC energy production of 11,571 kWh for Mattole School’s solar PV array. This is provided for context, supporting spreadsheets contain complete calculations.

Table 19 Summary of RCEAs annual energy production analysis.

| Annual AC Energy Production Based on System Size | |
|---|---------------|
| Module DC Rating (Watts) | 320.00 |
| Manufacturer Power Guarantee (%) | 0.98 |
| Number of Modules in Array | 25.00 |
| Array Guaranteed Power Output (kW) | 7.84 |
| | |
| Average Operating Temperature (°C) | 47.00 |
| Temperature Coefficient of Power (%/°C) | -0.0037 |
| Temp Corrected Array Power Output (kW) | 7.2018 |
| | |
| De-rate Factor (Soiling, Wire Loss, Mismatch) (%) | 0.10 |
| Net Array DC Output | 6.48 |
| | |
| Inverter Efficiency (%) | 0.97 |
| Maximum Power Point Tracking Efficiency | 1.00 |
| Inverter AC Output | 6.29 |
| | |
| Average Daily Insolation | 5.04 |
| Daily Energy Production (kWh) | 31.70 |
| | |
| Annual AC Energy Production (kWh) | 11,571 |

